

SITAC
Box 553
SE 371 23 Karlskrona
SWEDEN

Tfn.: +46-(0)10-516 63 00
Fax: +46-(0)455-206 88
E-mail: info@sitac.se



European Technical Approval ETA-11/0428

Handelsnamn

Trade name

Hilti Firestop Single Board Seal

Hilti Firestop Single Board Seal

Innehavare

Holder of approval

Hilti AG

Feldkircherstrasse 100

9494 Schaan

Liechtenstein

Produktbeskrivning och avsedd användning

Tätningssystem för genomföringar i brandavskiljande väggar och bjälklag i byggnader

Generic type and use
of construction product

Penetration seals for fire resistant walls and floors in
buildings

Giltighetstid

Validity:

från

from

t o m

to

2012-03-14

14.03.2012

2017-03-13

13.03.2017

Tillverkningsställe

Manufacturing plant

Hilti Werk 9a

Godkännandet innehåller

This Approval contains

34 sidor inklusive 4 bilagor

34 Pages including 4 Annexes



European Organisation for Technical Approvals

P900172

TABLE OF CONTENTS

I	LEGAL BASIS AND GENERAL CONDITIONS	3
II	SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL	4
1	Definition of product(s) and intended use.....	4
1.1	Definition of the construction product	4
1.1.1	Definition of the penetration seal.....	4
1.1.2	Definition of the components.....	4
1.1.2.1	Hilti Firestop Coating CFS-CT	4
1.1.2.2	Mineral wool (MW) boards.....	4
1.1.2.3	Hilti Firestop Board CFS-CT B 2S	4
1.1.2.4	Hilti Firestop Acrylic Sealant CFS-S ACR (see ETA-10/0292).....	4
1.1.2.5	Additional protection for cable/small conduit penetrations	5
1.1.2.6	Additional components for composite and plastic pipe penetrations.....	5
1.2	Intended use and use category.....	5
1.2.1	Intended use	5
1.2.2	Working life	6
1.2.3	Use Category.....	6
2	Characteristics of product(s) and methods of verification	6
2.1	Reaction to fire	7
2.2	Resistance to fire	8
2.3	Air permeability	8
2.4	Water permeability	9
2.5	Dangerous substances.....	9
2.6	Mechanical resistance and stability.....	9
2.7	Resistance to impact/movement	9
2.8	Adhesion.....	9
2.9	Airborne sound insulation	9
2.10	Thermal properties.....	10
2.11	Water vapour permeability	10
2.12	Durability and serviceability.....	10
2.12.1	Durability.....	10
2.12.2	Serviceability.....	10
3	Evaluation and attestation of conformity and CE-marking	11
3.1	System of attestation of conformity	11
3.2	Responsibilities	11
3.2.1	Tasks of the manufacturer.....	11
3.2.2	Tasks of approved bodies.....	12
3.3	CE marking.....	13
4	Assumptions under which the fitness of the product(s) for the intended use was favourably assessed	14
4.1	Manufacturing	14
4.2	Installation	14
5	Indications to the manufacturer.....	15
5.1	Packaging, transport and storage.....	15
5.2	Use, maintenance, repair	16
Annex A	REFERENCE DOCUMENTS and LIST OF ABBREVIATIONS	
Annex B	DESCRIPTION OF PRODUCT(S) & PRODUCT LITERATURE	
Annex C	RESISTANCE TO FIRE CLASSIFICATION OF PENETRATION SEALS HILTI FIRESTOP SINGLE BOARD SEAL	
Annex D	SPECIFICATION OF MINERAL WOOL BOARDS AND SPECIFIED PIPES	

I LEGAL BASIS AND GENERAL CONDITIONS

- 1 This European Technical Approval is issued by SITAC in accordance with:
 - Council Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations and administrative provisions of Member States relating to construction products¹, modified by Council Directive 93/68/EEC² and Regulation (EC) N° 1882/2003 of the European Parliament and of the Council³;
 - Common Procedural Rules for Requesting, Preparing and the Granting of European Technical Approvals set out in the Annex to Commission Decision 94/23/EC⁴;
 - Guideline for European Technical Approval of Fire Stopping and Fire Sealing Products: ETAG 026 Part 1: “General” and Part 2: “Penetration Seals”.
- 2 The SITAC is authorized to check whether the provisions of this European Technical Approval are met. Checking may take place in the manufacturing plant(s). Nevertheless, the responsibility for the conformity of the products to the European Technical Approval and for their fitness for the intended use remains with the holder of the European Technical Approval.
- 3 This European Technical Approval is not to be transferred to manufacturers or agents of manufacturers other than those indicated on page 1, or manufacturing plants other than those indicated on page 1 of this European Technical Approval.
- 4 This European Technical Approval may be withdrawn by SITAC, in particular pursuant to information by the Commission according to Article 5(1) of Council Directive 89/106/EEC.
- 5 Reproduction of this European Technical Approval including transmission by electronic means shall be in full. However, partial reproduction can be made with the written consent of SITAC. In this case partial reproduction has to be designated as such. Texts and drawings of advertising brochures shall not contradict or misuse the European Technical Approval.
- 6 The European Technical Approval is issued by the approval body in English. This version corresponds fully to the version circulated within EOTA. Translations into other languages have to be designated as such.

¹ Official Journal of the European Communities L 40, 11.2.1989, p. 12

² Official Journal of the European Communities L 220, 30.8.1993, p. 1

³ Official Journal of the European Union L 284, 31.10.2003, p. 1

⁴ Official Journal of the European Communities L 17, 20.1.1994, p. 34

II SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL

1 Definition of product(s) and intended use

1.1 Definition of the construction product

1.1.1 Definition of the penetration seal

Hilti Firestop Single Board Seal to reinstate the fire resistance performance of wall and floor constructions, where they have been provided with apertures for the penetration of services are made of one layer of mineral wool (MW) boards, the Hilti Firestop Coating CFS-CT, the Hilti Firestop Acrylic Sealant CFS-S ACR (to close any gaps between the opening edges and the seal or between services and the seal) and other components as listed in 1.1.2 depending on the type of services included.

The seal may be either formed by applying Hilti Firestop Coating CFS-CT on site onto a MW board as specified in Table D.1 or by using the pre-coated MW board Hilti Firestop Board CFS-CT B 2S (coated on two faces with Hilti Firestop Coating CFS-CT).

For details of the seal construction see Annex C.

1.1.2 Definition of the components

1.1.2.1 Hilti Firestop Coating CFS-CT

Hilti Firestop Coating CFS-CT is a white, ablative 1-component product and is composed essentially of filling substances and an acrylic binder.

Hilti Firestop Coating CFS-CT is supplied in pails/buckets of different sizes. The coating is sprayed or painted to mineral wool boards and partially on the services (for detail see Annex C). For the installation procedure see 4.2.1.

1.1.2.2 Mineral wool (MW) boards

For specification of suitable MW boards see Table D.1 in Annex D. For the installation procedure see 4.2.1.

1.1.2.3 Hilti Firestop Board CFS-CT B 2S

Hilti Firestop Board CFS-CT B 2S is a mineral wool board pre-coated on both faces with Hilti Firestop Coating CFS-CT. The board is supplied in sizes of 1000 x 600 x 50 mm and 1200 x 600 x 50 mm. The thickness of the coating is 0.7 mm. For the installation procedure see 4.2.2.

1.1.2.4 Hilti Firestop Acrylic Sealant CFS-S ACR (see ETA-10/0292)

Hilti Firestop Acrylic Sealant CFS-S ACR is used as filler to close any gaps between the opening edges and the seal or between services and the seal.

1.1.2.5 Additional protection for cable/small conduit penetrations

Depending on the required fire resistance additional protection (AP) may be required (for details see Annex C):

AP₁: cables / small conduits coated with Hilti Firestop Coating CFS-CT over a length of the cables / small conduits of 150 mm from the surface of the seal, thickness 0.7 mm.

AP₂: cables / small conduits coated with Hilti Firestop Coating CFS-CT over a length of the cables / small conduits of 150 mm from the surface of the seal, thickness 1 mm.

AP₃: cables / small conduits coated with Hilti Firestop Coating CFS-CT over a length of the cables / small conduits of 200 mm from the surface of the seal, thickness 1 mm.

AP₄: Mineral wool mat according to Table D.2, wrapped around cables / cable support (trays, ladders), Al-faced side outside, fixed with wire, width (length along the cables/small conduits) 200 mm, thickness 30 mm.

1.1.2.6 Additional components for composite and plastic pipe penetrations

Two types of pipe closure devices may be used as additional components (for detailed results see Annex C):

Hilti Firestop Collar CFS-C (see ETA-10/0403): for details see Annex C.

Hilti Firestop Wrap CFS-W EL and SG (see ETA-10/0405) is wrapped around the pipe on each side of the seal and positioned within the annular gap so that the outer edge of the wrap is flush with the surface of the wall. For necessary number of layers of the wrap and further details see Annex C.

1.2 Intended use and use category

1.2.1 Intended use

The intended use of Hilti Firestop Single Board Seal is to reinstate the fire resistance performance of flexible wall constructions, rigid wall constructions and rigid floor constructions where they are penetrated by services.

- (1) The specific elements of construction that Hilti Firestop Coating CFS-CT and Hilti Firestop Board CFS-CT B 2S may be used to provide a penetration seal in, are as follows:
 - a) Flexible walls: The wall must have a minimum thickness of 100 or 112 mm, respectively (for details see Annex C) and comprise timber or steel studs lined on both faces with one or several layers of boards of minimum 25 mm overall thickness. For timber stud walls there must be a minimum distance of 100 mm of the seal to any stud and the cavity between stud and seal must be closed and minimum 100 mm insulation of Class A1 or A2 (in accordance with EN 13501-1) in the cavity between stud and seal. An aperture framing must be installed made of C-studs and lining boards as used for the wall, minimum thickness of the board 12.5 mm.
 - b) Rigid walls: The wall must have a minimum thickness of 100 or 112 mm, respectively (for details see Annex C) and comprise concrete, blockwork or masonry, with a minimum nominal density of 650 kg/m³.

- c) Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 600 kg/m³.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

This ETA does not cover use of this product as a penetration seal in sandwich panel constructions.

- (2) Hilti Firestop Single Board Seal may be used to provide a penetration seal with the following specific services, single, multiple or in combination:

Blank seal	no services as given in Annex C
Cables	Services as given in Annex C
Metal pipes	Services as given in Annex C
Plastic pipes	Services as given in Annex C
Mixed (combination)	Services as given in Annex C

For the maximum seal size see Annex C.

- (3) Penetration seals require a minimum separation of 200 mm. For minimum distances between services within a penetration seal (multiple or mixed penetration seal) see Annex C.
- (4) Maximum distance (mm) from surface of the building element for first support / fixing of services: see Annex C.

1.2.2 Working life

The provisions made in this European Technical Approval are based on an assumed working life of a penetration seal made of Hilti Firestop Single Board Seal of 10 years, provided that the conditions laid down in sections 4.2/5.1/5.2 for the packaging / transport / storage / installation / use / repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

1.2.3 Use Category

The use category of Hilti Firestop Coating CFS-CT is Type Y₂. Since the requirements for type Y₂ are met, also the requirements for type Z₁ and Z₂ are fulfilled.

Type Y₂: Products intended for use at temperatures between -20 °C and + 70°C, but with no exposure to rain nor UV.

Type Z₁: Products intended for use at internal conditions with high humidity, excluding temperatures below 0°C.⁵

Type Z₂: Products intended for uses at internal conditions with humidity classes other than Z₁, excluding temperatures below 0°C.

2 Characteristics of product(s) and methods of verification

The identification tests and the assessment of the fitness for use according to the Essential Requirements were carried out in compliance with the “ETA Guidance no. 026-Part 2” concerning Penetration Seals – edition January 2008 (called ETAG 026-2 in this ETA).

⁵ These uses apply for internal humidity class 5 in accordance with EN ISO 13788

ETAG Clause No.	ETA Clause No.	Characteristic	Assessment of characteristic
Mechanical resistance and stability			
		None	Not relevant
Safety in case of fire			
2.4.1	2.1	Reaction to fire	Class D-s2 d0 according to EN 13501-1:2007
2.4.2	2.2	Resistance to fire	see clause 2.2 and Annex C to E
Hygiene, health and environment			
2.4.3	2.3	Air permeability (material property)	Flow rate per area
2.4.4	2.4	Water permeability (material property)	Water tight to 1000 mm head of water
2.4.5	2.5	Release of dangerous substances	Declaration of manufacturer
Safety in use			
2.4.6	2.6	Mechanical resistance and stability	No performance determined
2.4.7	2.7	Resistance to impact/movement	see clause 2.6
2.4.8	2.8	Adhesion	see clause 2.6
Protection against noise			
2.4.9	2.9	Airborne sound insulation	$R_w, D_{n,e,w}$
Energy economy and heat retention			
2.4.10	2.10	Thermal properties	See clause 2.10
2.4.11	2.11	Water vapour permeability	No performance determined
General aspects relating to fitness for use			
2.4.12	2.12	Durability and serviceability	Y ₂

2.1 Reaction to fire

The reaction to fire classification for Hilti Firestop Coating CFS-CT on a MW board is class 'D - s2 d0' in accordance with EN 13501-1. The reaction to fire classification of the mineral wool board used for Hilti Firestop Board CFS-CT B 2S is class A1.

2.2 Resistance to fire

Penetration seals Hilti Firestop Single Board Seal have been tested in accordance with EN 1366-3:2004, installed within apertures in rigid floors (cables, metal and plastic pipes), prEN 1366:2006 installed within apertures in flexible walls (cables, metal, composite and plastic pipes) and in accordance with EN 1366-3:2009, installed in flexible walls (drywalls) and concrete floors (cables). The seals were penetrated by cables, tied cable bundles, small conduits, steel and copper pipes, including pipes with insulation, composite pipes and plastic pipes.

Based upon these test results and the field of direct application specified within EN 1366-3:2009, penetration seals Single Board Seal have been classified in accordance with EN 13501-2, as shown in Annex C.

The seals may only be penetrated by the services described in Annex C. Other parts or support constructions must not penetrate the seal.

For details of suitable wall and floor constructions for penetration seals see 1.2.1.

The service support construction must be fixed to the building element containing the penetration seal or a suitable adjacent building element, on both sides of the penetration in such a manner that in the case of fire, no additional load is imposed on the seal. Furthermore it is assumed that this support is maintained on the unexposed side, for the required period of fire resistance.

Specific considerations:

- Pipes must be perpendicular to the seal surface.
- It is assumed that compressed air systems are switched off by other means in the case of fire.
- The function of the pipe seal in case of pneumatic dispatch systems, pressurised air systems etc. is guaranteed only when the systems are shut off in case of fire.
- The approval does not address any risks associated with leakage of dangerous liquids or gases caused by failure of the pipe(s) in case of fire.
- The durability assessment does not take account of the possible effect of substances permeating through the pipe on the penetration seal.
- The classifications relate to C/U (capped inside the furnace/uncapped outside) for metal pipes and U/C (uncapped inside the furnace/capped outside) for plastic and composite pipes. For further information refer to national regulations.

The total cross section of the cables (including cable support systems like cable trays etc.) and pipes (the outer diameter to be considered) must not be more than 60% of the total seal (opening) size.

2.3 Air permeability

The gas permeability regarding the gases air, nitrogen (N₂), carbon dioxide (CO₂) and CH₄ (methane) has been tested according to the principles of EN 1026 for a coating thickness of 1 mm (CO₂ and CH₄) and 2 mm (N₂). The following flow rates per area (q/A) have been achieved for the given air pressure differences (Δp). The flow rate index indicates the type of gas:

Gas permeability of Hilti Firestop Coating CFS-CT

Δp [Pa]	q/A N ₂ [m ³ /(h·m ²)]	q/A CO ₂ [m ³ /(h·m ²)]	q/A CH ₄ [m ³ /(h·m ²)]
50	≤ 0.032	≤ 0.060	≤ 0.065
250	≤ 0.159	≤ 0.299	≤ 0.327

The declared values refer to a body of pure Hilti Firestop Coating CFS-CT on mineral wool board without any penetrating installation.

2.4 Water permeability

The water permeability has been tested according to Annex C of ETAG 026-2. The specimen consisted of 0.7 mm Hilti Firestop Coating CFS-CT (dry film thickness) on mineral wool. Test result: Water tight to 1000 mm head of water or 9806 Pa.

2.5 Dangerous substances

According to the manufacturer's declaration, the product specification has been compared with the list of dangerous substances of the European Commission to verify that that it does not contain such substances above the acceptable limits.

A written declaration in this respect was submitted by the ETA-holder.

In addition to the specific clauses relating to dangerous substances contained in this ETA, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Product Directive, these requirements need also to be complied with, when and where they apply.

2.6 Mechanical resistance and stability

No performance determined

2.7 Resistance to impact/movement

See 2.6

2.8 Adhesion

See 2.6

2.9 Airborne sound insulation

Test reports from noise reduction according to EN ISO 140-3, EN ISO 140-10 and EN ISO 717-1 have been provided.

The acoustic tests were performed in a flexible wall and in a rigid wall. The acoustic characteristics of the walls itself have not been measured. According to these tests reports the single number ratings are:

	Flexible wall	Rigid wall
Nominal density of board [kg/m ³]	150	150
No. of board faces coated	2	2
Air gap between boards [mm]	-	-
Specimen size [mm x mm]	600 x 500	620 x 520
D _{n,e,w} (C; Ctr) [dB]	39 (-2;-4)	30 (-2;-3)
R _w (C; Ctr) [dB]	32 (-2;-4)	23 (-2;-3)

Test setup: As test specimen a mineral wool board of 150 kg/m³ density has been used, coated with Hilti Firestop Coating CFS-CT on both sides. The coating thickness was 1 mm. The joints around the board have been sealed with Hilti Firestop Acrylic Sealant CFS-S ACR.

Structure of the flexible wall: 2 x 12.5 mm plasterboard on both sides of a 50 mm metal stud frame. The void was filled with a 40 mm mineral wool slab.

Structure of the rigid wall: 175 mm thick concrete wall with a density of 2000 kg/m³ which was plastered on both sides. The opening was reduced to the test specimen size by means of block work of 175 mm thickness, plastered on both sides and a pre-fabricated concrete frame.

It should be noticed that both above mentioned results apply to the total wall construction of the size 1.25 m x 1.50 m (= 1.88 m²), i.e. the given wall with 0.322 m² Hilti Firestop Single Board Seal in case of rigid walls and a size of 1.38 x 1.5 m (= 2.07 m²), i.e. the given wall with 0.30 m² and 0.20 m² respectively seal Hilti Firestop Single Board Seal in case of flexible walls.

$D_{n,e,w}$: weighted element-normalized level difference of small building elements (given with spectrum adaptation terms C and C_{tr})

R_w : weighted sound reduction index (given with spectrum adaptation terms C and C_{tr})

2.10 Thermal properties

The insulation performance of a mineral wool slab is slightly reduced by the coating, 3.0 to 3.4% with double-sided coating. This has to be considered on selecting a mineral wool board if a required regulatory nominal λ -value has to be achieved.

2.11 Water vapour permeability

No performance determined

2.12 Durability and serviceability

2.12.1 Durability

Hilti Firestop Coating CFS-CT has been tested in accordance with EOTA Technical Report TR024, Table 4.1 for the Y₂ use category specified in EOTA ETAG 026: Part 2 and the results of the test have demonstrated suitability for penetration seals intended for use at temperatures between -20°C and +70°C but with no exposure to rain nor UV (Y₂).

2.12.2 Serviceability

2.12.2.1 Flexibility Hilti Firestop Coating CFS-CT

The flexibility of Hilti Firestop Coating CFS-CT has been tested in accordance with EN ISO 1519 with the result of no crack formation on a mandrel of 2 mm diameter for a coating thickness of 1.0 mm.

2.12.2.2 Compatibility of Hilti Firestop Coating CFS-CT with metals / plastics

Hilti Firestop Coating CFS-CT has been tested in accordance with EOTA Technical Report TR024, 4.3.6 for compatibility in permanent contact with metals and plastics with the result of no interaction with copper, galvanised steel and stainless steel as well as PE, PVC and ABS.

3 Evaluation and attestation of conformity and CE-marking

3.1 System of attestation of conformity

According to the Decision 1999/454/EC of the European Commission⁶ system 1 of the attestation of conformity applies.

This system of attestation of conformity is defined as follows:

System 1: Certification of the conformity of the product by an approved certification body on the basis of:

- (a) Tasks for the manufacturer:
 - (1) factory production control;
 - (2) further testing of samples taken at the factory by the manufacturer in accordance with a prescribed test plan;
- (b) Tasks for the approved body:
 - (3) initial type-testing of the product;
 - (4) initial inspection of factory and of factory production control;
 - (5) continuous surveillance, assessment and approval of factory production control.

3.2 Responsibilities

3.2.1 Tasks of the manufacturer

3.2.1.1 Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall insure that the product is in conformity with this European Technical Approval.

The manufacturer may only use constituent materials stated in the technical documentation of this European Technical Approval.

For the components which the ETA-holder does not manufacture by himself, he shall make sure that factory production control carried out by the other manufacturers gives the guaranty of the components compliance with the European Technical Approval.

The factory production control and the provisions taken by the ETA-holder for components not produced by himself shall be in accordance with the "Control relating to the European Technical Approval ETA-11/0428" which is part of the technical documentation of this European Technical Approval. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at the SITAC.⁷

⁶ Official Journal of the European Communities N° L 178, 14,7,1999, p. 52

⁷ The Control Plan is a confidential part of the European Technical Approval and only handed over to the approved body or bodies involved in the procedure of attestation of conformity.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the "Control Plan".

3.2.1.2 Other tasks of manufacturer

The manufacturer shall, on the basis of a contract, involve a body (bodies) which is (are) approved for the tasks referred to in section 3.1 in the field of penetration seals in order to allow the manufacturer to undertake the actions laid down in section 3.3. For this purpose, the "Control Plan" referred to in sections 3.2.1.1 and 3.2.2 shall be handed over by the manufacturer to the approved body or bodies involved.

The manufacturer shall make a declaration of conformity, stating that the construction product is in conformity with the provisions of the European Technical Approval ETA-11/0428 issued on 14.03.2012.

Additional information

The manufacturer shall provide a technical data sheet and installation instruction with the following minimum information:

Technical data sheet:

- Field of application:
 - Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and – in case of lightweight constructions – the construction requirements.
 - Services for which the penetration seal is suitable, type and properties of the services like material, diameter, thickness etc. in case of pipes including insulation materials; necessary/allowed supports/fixings (e.g. cable trays)
 - Limits in size, minimum thickness etc. of the penetration seal
- Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication where they are generic or specific.

Installation instruction:

Steps to be followed

Procedure in case of retrofitting

Stipulations on maintenance, repair and replacement

3.2.2 Tasks of approved bodies

The approved body (bodies) shall perform the

- initial type-testing of the product,
- initial inspection of factory and of factory production control,
- continuous surveillance, assessment and approval of factory production control,

in accordance with the provisions laid down in the "Control Plan of relating to the European Technical Approval ETA-11/0428".

The approved body (bodies) shall retain the essential points of its (their) actions referred to above and state the results obtained and conclusions drawn in (a) written report (reports).

The approved certification body involved by the manufacturer shall issue an EC certificate of conformity of the product stating the conformity with the provisions of this European Technical Approval.

In cases where the provisions of the European Technical Approval and its "Control Plan" are no longer fulfilled the certification body shall withdraw the certificate of conformity and inform the SITAC without delay.

3.3 CE marking

The CE marking shall be affixed on the product itself, on a label attached to it, on its packaging or on the commercial documents accompanying the components of the product unit. The marking „CE“ shall be followed by the identification number of the approved certification body and be accompanied by the following additional information:

- the name and address of the producer (legal entity responsible for the manufacturer),
- the last two digits of the year in which the CE marking was affixed,
- the number of the EC certificate of conformity for the product,
- the number of the European Technical Approval,
- the number of the guideline for European Technical Approval
- the penetration seal name and use category/categories of the product as listed in accordance with the provisions of the ETAG
- “see ETA-11/0428 for relevant characteristics”

Example of CE marking and accompanying information for Hilti Firestop Single Board Seal:

	"CE"-marking
1234	Identification number of approved certification body
Hilti AG Feldkircherstrasse 100, Schaan, Liechtenstein	Name and address of the producer (legal entity responsible for the manufacturer)
04	Two last digits of year of affixing the CE marking
1234-CPD-0321	Number of EC certificate of conformity
ETA-11/0428	Number of European Technical Approval
ETAG N° 026 part 2	Number of guideline for European Technical Approval
Hilti Firestop Coating CFS-CT for Penetration Seal	Name
Hilti Firestop Single Board Seal	
“see ETA-11/0428 for relevant characteristics”	Reference to ETA for relevant characteristics

4 Assumptions under which the fitness of the product(s) for the intended use was favourably assessed


4.1 Manufacturing

The European Technical Approval is issued for the product on the basis of agreed data/information, deposited with the SITAC, which identifies the product that has been assessed and judged. Changes to the product or production process, which could result in this deposited data/information being incorrect, shall be notified to the SITAC before the changes are introduced. The SITAC will decide whether or not such changes affect the ETA and consequently the validity of the CE marking on the basis of the ETA and if so whether further assessment or alterations to the ETA, shall be necessary.


4.2 Installation

The ETA is issued under the assumption that the installation of the approval product is performed in accordance with the manufacturer's technical literature.


4.2.1 Installation of the penetration seal, when using a MW board according to Table D.1 and Hilti Firestop Coating CFS-CT, should be conducted as follows:

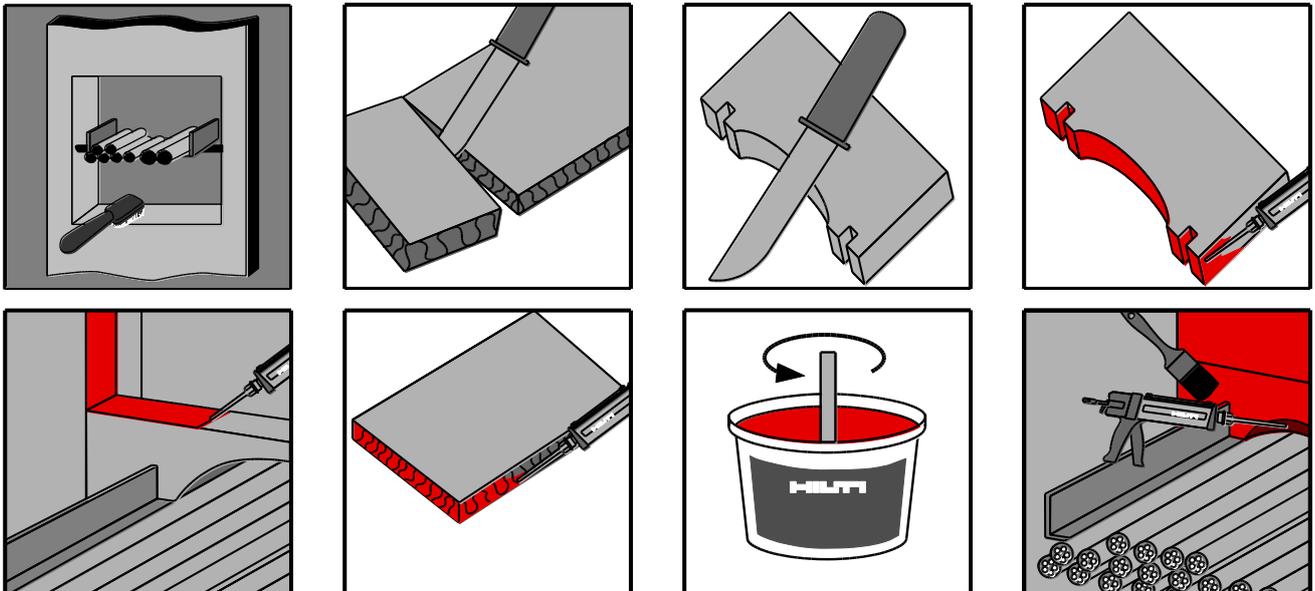


- In case AP1, AP2 or AP3 is required:




- In case AP4 is required:





4.2.2 Installation of the penetration seal, when using the pre-coated on Hilti Firestop Board CFS-CT B 2S, should be conducted as follows:

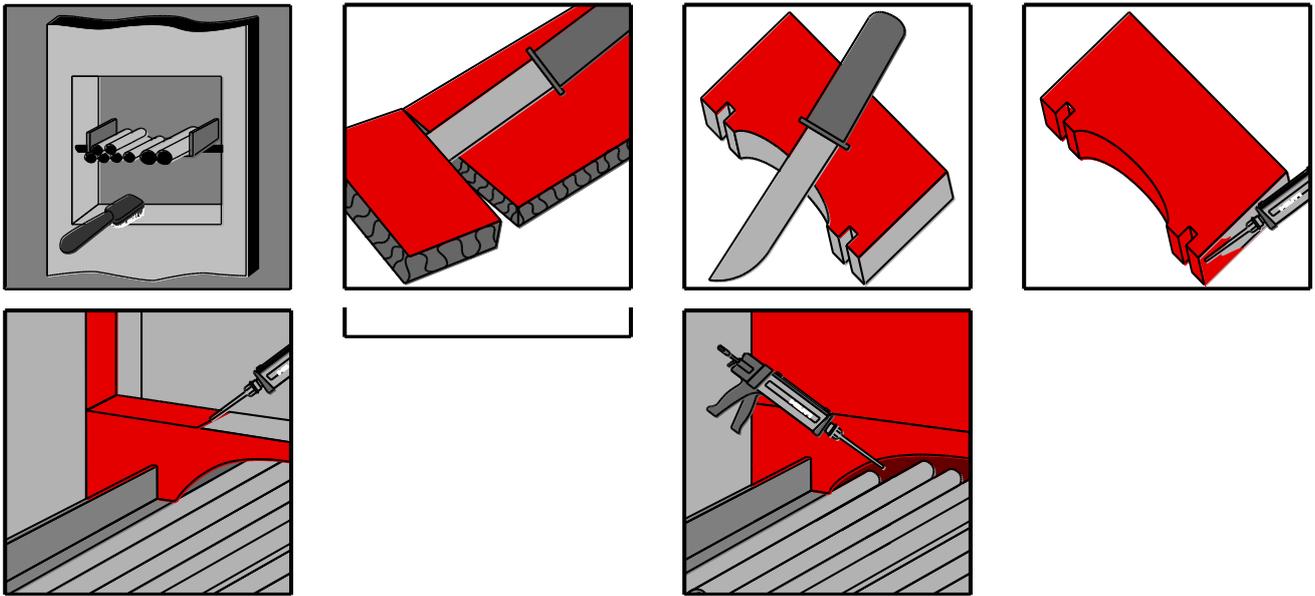

- In case AP1, AP2 or AP3 is required:



- In case AP4 is required:



- Application temperature: +5°C to +40°C.

Re-penetration / removal of services

If single services (cables, pipes) are installed later on, a hole is drilled through the mineral wool panel and the services passed through; the remaining annular space has to be sealed with Hilti Firestop Acrylic Sealant CFS-S ACR. In case the coating has been damaged during installation of the additional service it must be repaired. Depending on the type of service and the required fire resistance additional firestopping components, e.g. Hilti Firestop Collars CFS-C or Hilti Firestop Wraps CFS-W or additional protections AP₁ to AP₄ according to 1.1.2.5 may be necessary – for details see Annex C.

In case services are removed the remaining hole has to be filled with mineral wool according to the specification given in Table D.1 and coated with Hilti Firestop Coating CFS-CT. Before coating any gaps have to be filled with Hilti Firestop Acrylic Sealant CFS-S ACR.

5 Indications to the manufacturer

5.1 Packaging, transport and storage

In the accompanying document and/or on the packaging the manufacturer shall give information as to transport and storage.

At least the following shall be indicated: storing temperature, type of storage, maximum duration of storage and required data related to minimum temperature for transport and storage.

Storage: Store in a dry place protected from moisture

Storage temperature: -5° up to max. +50°C

5.2 Use, maintenance, repair


The Hilti Firestop Coating CFS-CT and the Hilti Firestop Boards CFS-CT B 2S should be installed and used as described earlier in this document.

The assessment of the fitness for use is based on the assumption that damage, for example caused by accidental impact, is repaired. The relevant manufacturer instructions shall be followed.

On behalf of SITAC

Borås, 14 March 2012

Lennart Månsson

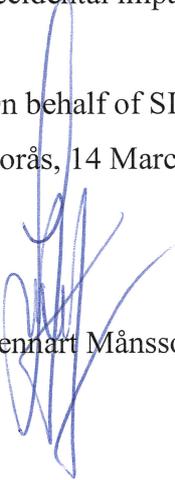

ANNEX A

REFERENCE DOCUMENTS and LIST OF ABBREVIATIONS

A.1 References to standards mentioned in the ETA

DIN 8061	Unplasticized polyvinyl chloride (PVC-U) pipes - General quality requirements and testing
DIN 8062	Unplasticized polyvinyl chloride (PVC-U) pipes - Dimensions
DIN 8074	Polyethylene (PE) - Pipes PE 63, PE 80, PE 100, PE-HD - Dimensions
DIN 8075	Polyethylene (PE) pipes - PE 63, PE 80, PE 100, PE-HD - General quality requirements, testing
DIN 19531-10	Pipes and fittings made of unplasticized polyvinyl chloride (PVC-U) socket for waste and soil discharge systems inside buildings - Part 10: Fire behaviour, quality control and installation recommendations
EN 1026	Windows and doors – Air permeability – Test method
EN 1329-1	Plastics piping systems for soil and waste discharge (low and high temperature) within the building structure - Unplasticized poly(vinyl chloride) (PVC-U) - Part 1: Specifications for pipes, fittings and the system
EN 1366-3	Fire resistance tests for service installations - Part 3: Penetration seals
EN 1453-1	Plastics piping systems with structured-wall pipes for soil and waste discharge (low and high temperature) inside buildings - Unplasticized poly(vinyl chloride) (PVC-U) - Part 1: Specifications for pipes and the system
EN 12667	Thermal performance of building materials and products – Determination of thermal resistance by means of guarded hot plate and heat flow meter methods – Products of high and medium thermal resistance
EN 13501-1	Fire classification of construction products and building elements – Part 1: Classification using test data from reaction to fire tests
EN 13501-2	Fire classification of construction products and building elements – Part 2: Classification using test data from fire resistance tests
EN 14303	Thermal insulation products for building equipment and industrial installations - Factory made mineral wool (MW) products - Specification
EN ISO 140-3	Acoustics – Measurement of sound insulation in buildings and of building elements – Part 3: Laboratory measurements of airborne sound insulation of building elements
EN ISO 140-10	Acoustics – Measurements of sound insulation in buildings and of building elements – Part 10: Laboratory measurement of airborne sound insulation of small building elements
EN ISO 717-1	Acoustics – Rating of sound insulation of buildings and of building elements – Part 1: Airborne sound insulation
EN ISO 1452-2	Plastics piping systems for water supply and for buried and above-ground drainage and sewerage under pressure - Unplasticized poly(vinyl chloride) (PVC-U) - Part 2: Pipes
EN ISO 1519	Paints and varnishes – Bend test (cylindrical mandrel)
EN ISO 4032	Hexagon nuts, style 1 - Product grades A and B
EN ISO 7089	Plain washers - Normal series - Product grade A
EN ISO 15493	Plastics piping systems for industrial applications - Acrylonitrile-butadiene-styrene (ABS), unplasticized poly(vinyl chloride) (PVC-U) and chlorinated poly(vinyl chloride) (PVC-C) - Specifications for components and the system; Metric series
EN ISO 15494	Plastics piping systems for industrial applications - Polybutene (PB), polyethylene (PE) and polypropylene (PP) - Specifications for components and the system; Metric series

- EN ISO 15875-1 Plastics piping systems for hot and cold water installations - Crosslinked polyethylene (PE-X) - Part 1: General
- EN ISO 15875-2 Plastics piping systems for hot and cold water installations - Crosslinked polyethylene (PE-X) - Part 2: Pipes

A.2 Other reference documents

- EOTA TR 001 Determination of impact resistance of panels and panel assemblies
- EOTA TR 024 Characterisation, Aspects of Durability and Factory Production Control for Reactive Materials, Components and Products

A.3 Abbreviations used in drawings

Abbreviation	Description
A ₁	Mineral wool board coated with Hilti Firestop Coating CFS-CT or Hilti Firestop Coated Board CFS-CT B 2S
A ₃	Hilti Firestop Collar CFS-C
A ₄	Hilti Firestop Wrap CFS-W EL or SG
AP ₁ to AP ₄	Additional protection for services
C, C ₁ , C ₂ , C ₃	Penetrating services
D	Pipe insulation
d _c	Pipe diameter
E	Building element (wall, floor)
h	Height of the penetration seal
l	Length of the penetration seal
L _{AP}	Length of the additional protection
L _D	Length of the pipe insulation
s ₁ , s ₂	Distances
t _c	Pipe wall thickness
t _D	Thickness of insulation
t _E	Thickness of the building element
w	Width of the penetration seal

ANNEX B

DESCRIPTION OF PRODUCT(S) & PRODUCT LITERATURE

B.1 Hilti Firestop Coating CFS-CT

A detailed specification of the product is contained in document "Identification / Product Specification relating to the European Technical Approvals ETA-11/0428 and ETA-11/0429 - Hilti Firestop Coating CFS-CT" which is a non-public part of this ETA.

The "Control Plan" is defined in document "Control Plan relating to the European Technical Approvals ETA-11/0428 and ETA-11/0429 - Hilti Firestop Coating CFS-CT" which is a non-public part of this ETA.

B.2 Hilti Firestop Board CFS-CT B 2S

A detailed specification of the product is contained in document "Identification / Product Specification relating to the European Technical Approval ETA-11/0428 and ETA-11/0429 - Hilti Firestop Board CFS-CT B 2S" which is a non-public part of this ETA.

The "Control Plan" is defined in document "Control Plan" relating to the European Technical Approval ETA-11/0428 and ETA-11/0429 - Hilti Firestop Board CFS-CT B 2S" which is a non-public part of this ETA.

B.3 Hilti Firestop Acrylic Sealant CFS-S ACR

For specification and further details see ETA-10/0292

B.4 Hilti Firestop Collar CFS-C

For specification and further details see ETA-10/0403

B.5 Hilti Firestop Wrap CFS-W

For specification and further details see ETA-10/0405

B.6 Fixing for Hilti Firestop Collars CFS-C

- Threaded rods M8, galvanised, minimum strength category 4.6
- Nuts M8, galvanised (e.g. according to EN ISO 4032)
- Washers:
 - at a collar hook: A 8.4-28 s = 2 mm, galvanised (e.g. according to EN ISO 7089)
 - at the top side of a floor seal: A 8.4-40 s = 3 mm, galvanised (e.g. according to EN ISO 7089)

B.7 Technical product literature

- Technical data sheet Hilti Firestop Single Board Seal – Hilti Firestop Coating CFS-CT (including all components as defined in 1.1.2).
- Safety Data Sheet acc. to 1907/2006/EC, Article 31, for Hilti Firestop Coating CFS-CT

ANNEX C

RESISTANCE TO FIRE CLASSIFICATION OF PENETRATION SEALS HILTI FIRESTOP SINGLE BOARD SEAL

C.1 Flexible walls according to 1.2.1 and rigid walls according to 1.2.1 b), minimum thickness 100 mm

Penetration seal:

50 mm Hilti Firestop Board CFS-CT B 2S (A₁) or a mineral wool board according to Table D.1 coated with Hilti Firestop Coating CFS-CT (A₁), dry thickness of coating 0.7 mm on both sides, all cut edges of boards sealed with Hilti Firestop Acrylic Sealant CFS-S ACR, remaining gaps around cables / cable supports (trays, ladders etc.) and other services filled with Hilti Firestop Acrylic Sealant CFS-S ACR.

The board may be positioned flush to the surface of the building element or in any position within the building element.

Maximum distance for 1st service support: 250 mm.

Maximum seal size: 1175 x 600 mm (width x height).

Minimum distances in mm (see illustration below):


$s_1 = 50$ (distance between cables/cable supports and seal edge)

$s_2 = 0$ (distance between cable supports)

$s_3 = 0$ (distance between cables and upper seal edge)

$s_4 = 0$ (distance between cable supports and bottom seal edge)

$s_5 = 80$ (distance between cables and cable support above)

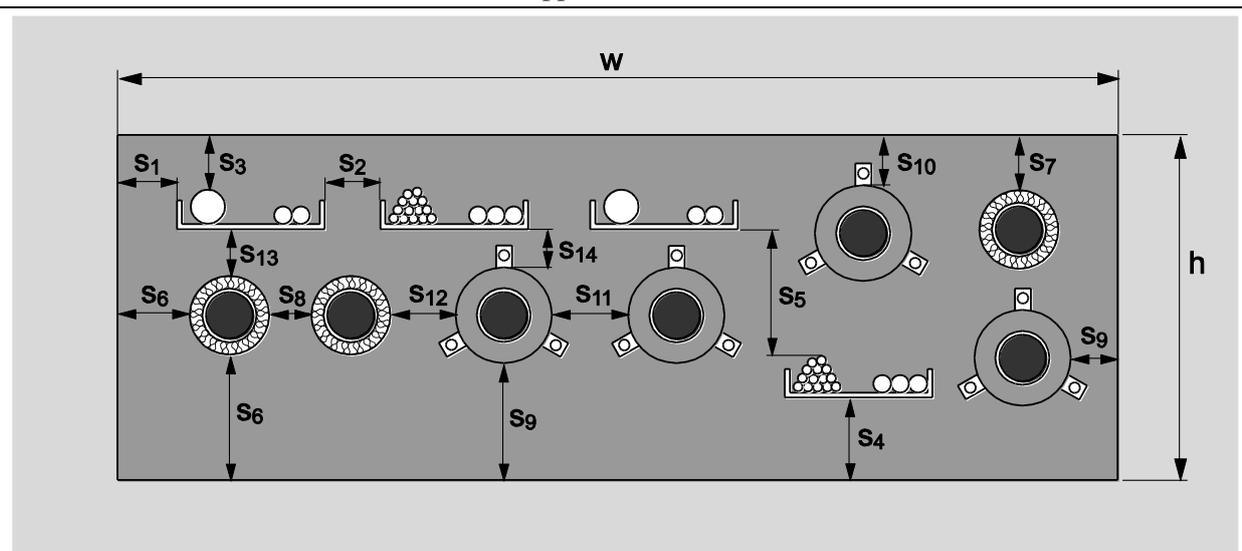

Penetrating services (single, multiple or mixed):	
C.1.1 Blank seal (no services) *	
Construction details (for symbols and abbreviations see Annex A.3):	Classification
	EI 45
* If services are added later on in a blank seal only the services listed in the tables below may be added that fulfil the required classification	

C.1.2 Cables	
Construction details (for symbols and abbreviations see Annex A.3):	
	Classification
Additional protection according to 1.1.2.5:	AP ₂ AP ₄
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, with or without cable supports, with a maximum diameter of 80 mm, with or	EI 30 EI 45

without cable supports		
Tied cable bundle, maximum diameter 100 mm, maximum diameter of single cable 21 mm, with or without cable supports	EI 30	EI 45

C.1.3 Small conduits and tubes		
Construction details: see C.1.2	Classification	
$\varnothing \leq 16$ mm, wall thickness ≥ 1 mm, arranged linear, with or without cables, with or without cable supports		
Additional protection according to 1.1.2.5:	AP ₂	AP ₄
Plastic conduits and tubes	EI 45 U/C	EI 45 U/C
Steel conduits and tubes	-	EI 30 C/U

C.2 Flexible walls according to 1.2.1 and rigid walls according to 1.2.1 b), minimum thickness 112 mm	
<p>Penetration seal: 50 mm Hilti Firestop Board CFS-CT B 2S (A₁) or a mineral wool board according to Table D.1 coated with Hilti Firestop Coating CFS-CT (A₁), dry thickness of coating 0.7 mm on both sides, all cut edges of boards sealed with Hilti Firestop Acrylic Sealant CFS-S ACR, remaining gaps around cables / cable supports (trays, ladders etc.) and other services filled with Hilti Firestop Acrylic Sealant CFS-S ACR. The board may be positioned flush to the surface of the building element or in any position within the building element. Maximum distance for 1st service support: 250 mm. Maximum seal size: 1175 x 600 mm (width x height). Minimum distances in mm (for illustration see C.1): s₁ = 0 (distance between cables/cable supports and seal edge) s₂ = 0 (distance between cable supports) s₃ = 0 (distance between cables and upper seal edge) s₆ = 10 (distance between metal pipes and seal edge) s₈ = 0 (distance between metal pipes) s₉ = 77 (distance between plastic pipes/pipe closure devices and seal edge) s₁₁ = 0 (distance between plastic pipes/pipe closure devices) s₁₂ = 49 (distance between metal pipes and plastic pipes/pipe closure devices) s₁₃ = 56 (distance between cables/cable supports and metal pipes) s₁₄ = 32 (distance between cables/cable supports and plastic pipes/pipe closure devices)</p>	
<p>Penetrating services (single, multiple or mixed): In addition to the services referred to in C.1 the following services with the classifications given below are covered:</p>	
C.2.1 Cables	
Construction details: see C.1.2	Classification
Additional protection according to 1.1.2.5:	AP ₁
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, with or without cable supports, with a maximum diameter of 80 mm, with or without cable supports	EI 45
Non-sheathed cables (wires) currently and commonly used in building practice in Europe, with or without cable supports, with a maximum diameter of 17 mm	EI 45
Tied cable bundle, maximum diameter 100 mm, maximum diameter of single cable 21 mm, with or without cable supports	EI 45

C.2.2 Small conduits and tubes	
Construction details: see C.1.2	
	Classification
Additional protection according to 1.1.2.5:	AP ₁
Ø ≤ 16 mm, wall thickness ≥ 1 mm, arranged linear, with or without cables, with or without cable supports	
Plastic conduits and tubes	EI 45 U/C
Steel conduits and tubes	EI 45 C/U

C.2.3 Metal pipes with mineral wool insulation according to Table D.3				
Construction details (for symbols and abbreviations see Annex A.3):				
<p>Continued insulation, interrupted (CI)</p>	<p>Local insulation, interrupted (LI)</p>			
Steel pipes (C) with continued insulation (D) – interrupted				
Insulation thickness (t _D) [mm]	Pipe diameter (d _C) [mm]	Pipe wall thickness (t _C) [mm]	Classification	
≥ 20	32	4.0 – 14.2	EI 45-C/U	
≥ 30	32 – 114.3	3.6 – 14.2	EI 45-C/U	
Steel pipes (C) with local insulation (D) – interrupted				
Insulation		Pipe		Classification
thickness (t _D) [mm]	length (L _D) [mm]	diameter (d _C) [mm]	wall thickness (t _C) [mm]	
20	≥ 500	32	4.0 – 14.2	EI 45-C/U
30	≥ 500	114.3	3.6 – 14.2	EI 45-C/U
The field of application given above for steel pipes is also valid for other metal pipes with lower heat conductivity than unalloyed steel and a melting point of minimum 1050°C, e.g. cast iron, stainless steels, Ni alloys (NiCu, NiCr and NiMo alloys)				

Copper pipes (C) with continued insulation (D) – interrupted				
Insulation thickness (t_D) [mm]	Pipe diameter (d_C) [mm]	Pipe wall thickness (t_C) [mm]	Classification	
≥ 20	42	1.5 – 14.2	EI 45-C/U	
Copper pipes (C) with local insulation (D) – interrupted				
Insulation		Pipe		Classification
thickness (t_D) [mm]	length (L_D) [mm]	diameter (d_C) [mm]	wall thickness (t_C) [mm]	
20	≥ 500	42	1.5 – 14.2	


The field of application given above for copper pipes is also valid for other metal pipes with lower heat conductivity than copper and a melting point of minimum 1100°C, e.g. cast iron, stainless steels, Ni alloys (NiCu, NiCr and NiMo alloys) and Ni.

C.2.4 Plastic pipes

C.2.4.1 Plastic pipes with Hilti Firestop Collar CFS-C

Construction details (for symbols and abbreviations see Annex A.3):

Hilti Firestop Collars CFS-C are installed on both sides of the seal, fixed together by threaded rods, washers and nuts as specified in Annex B.7.

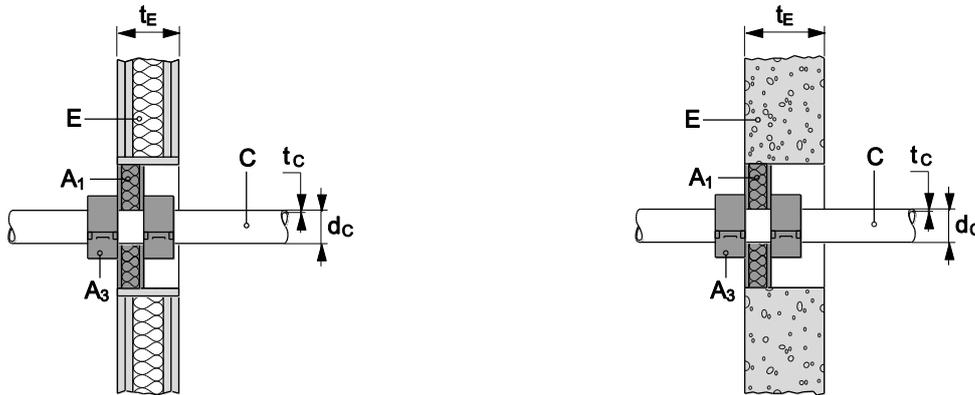

PVC-U pipes (C) according to EN ISO 1452-2, EN ISO 15493 and DIN 8061/8062

Pipe diameter d_c (mm)	Pipe wall thickness t_c (mm)	Collar size (A_1)	No. of hooks	Classification
32	1.8	CFS-C 50/1.5"	2	EI 45-U/C
110	2.2 – 8.2	CFS-C 110/4"	4	EI 45-U/C

The results are also valid for PVC-U pipes according EN 1329-1⁸ and EN 1453-1⁸.

PE-X pipes according to EN ISO 15875 (see Table D.4)

Pipe diameter d_c (mm)	Pipe wall thickness t_c (mm)	Collar size (A_1)	No. of hooks	Classification
12	2.0	CFS-C 50/1.5"	2	EI 45-U/C
Bundle of 3 pipes 12x2	-	CFS-C 50/1.5"	2	EI 45-U/C


⁸ In Germany the pipes have additionally to comply with DIN 19531-10

32	4.5	CFS-C 50/1.5''	2	EI 45-U/C
Pipe-in-pipe (PE-X in PE-HD ducting, see Table D.5)				
Pipe dimensions (mm)		Collar size (A ₁)	No. of hooks	Classification
PE-X 12x2 + PE-HD 25/20		CFS-C 50/1.5''	2	EI 45-U/C
PE-X 28x4 + PE-HD 54/44		CFS-C 63/2''	2	EI 45-U/C
Bundle of 3 PE-X 22x3 + PE_HD 34/28		CFS-C 110/4''	4	EI 45-U/C

C.2.4.2 Plastic pipes with Hilti Firestop Wrap CFS-W

Construction details (for symbols and abbreviations see Annex A.3):

The number of layers of Firestop Wrap CFS-W (A₂) given below is wrapped around the pipe on each side of the seal and positioned within the annular gap so that the outer edge of the wrap is flush with the surface of the seal.

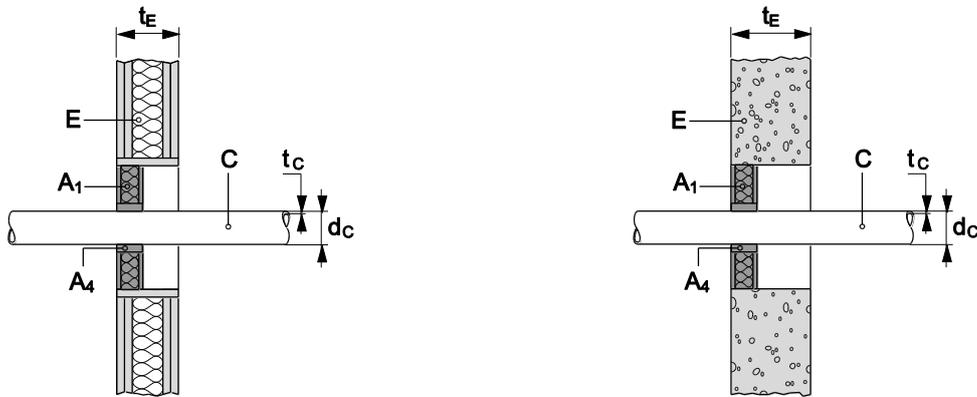

PVC-U pipes (C) according to EN ISO 1452-2, EN ISO 15493 and DIN 8061/8062

Pipe diameter d _c (mm)	Pipe wall thickness t _c (mm)	No. of layers of Hilti Firestop Wrap CFS-W EL	Classification
32	1.8	2	EI 45-U/C
110	2.2 – 8.2	2	EI 45-U/C

The results are also valid for PVC-U pipes according EN 1329-1⁸ and EN 1453-1⁸.

PE pipes (C) according to EN ISO 15494 and DIN 8074/8075

Pipe diameter d _c (mm)	Pipe wall thickness t _c (mm)	No. of layers of Hilti Firestop Wrap CFS-W EL	Classification
32 - 110	1.8/2.7 ⁹ – 6.3	2	EI 45-U/C

PE-X pipes according to EN ISO 15875 (see Table D.4)

Pipe diameter d _c (mm)	Pipe wall thickness t _c (mm)	No. of layers of Hilti Firestop Wrap CFS-W EL	Classification
12	2.0	1	EI 45-U/C
Bundle of 3 pipes 12x2	-	1	EI 45-U/C
32	4.5	1	EI 45-U/C

⁹ Interpolation for minimum wall thickness between 1.8 mm for 32 mm diameter pipes and 2.7 mm for 110 mm diameter pipes

Pipe-in-pipe (PE-X in PE-HD ducting, see Table D.5)		
Pipe dimensions (mm)	No. of layers of Hilti Firestop Wrap CFS-W EL	Classification
PE-X 12x2 + PE-HD 25/20	1	EI 45-U/C
PE-X28x4 + PE-HD 54/48	1	EI 45-U/C
Bundle of 3 PE-X 22x3 + PE-HD 34/28	1	EI 45-U/C

C.2.5 Composite pipes				
Pipes: "Geberit Mepla" composite pipes (PE-Xb/Al/PE-HD) of Geberit Vertriebs AG, a company of the Geberit Group				
C.2.5.1 Composite pipes Geberit Mepla with Hilti Firestop Collar CFS-C				
Construction details: see C.2.4.1				
Pipe diameter d_c (mm)	Pipe wall thickness t_c (mm)	Collar size (A_1)	No. of hooks	Classification
16	2.25	CFS-C 50/1.5"	2	EI 45-U/C

C.2.5.2 Composite pipes Geberit Mepla with Hilti Firestop Wrap CFS-W			
Construction details: see C.2.4.2			
Pipe diameter d_c (mm)	Pipe wall thickness t_c (mm)	No. of layers of Hilti Firestop Wrap CFS-W	Classification
16	2.25	1	EI 45-U/C

C.2.5.3 Composite pipes Geberit Mepla with mineral wool insulation according to Table D.3 and with Hilti Firestop Wrap CFS-W				
Construction details (for symbols and abbreviations see Annex A.3): 1 layer of Firestop Wrap CFS-W (A_2) is wrapped around the pipe on each side of the seal and positioned within the annular gap so that the outer edge of the wrap is flush with the surface of the wall.				
Composite pipes (C) with continued insulation (D) – interrupted				
Insulation thickness (t_D) [mm]	Pipe diameter (d_C) [mm]	Pipe wall thickness (t_C) [mm]	Classification	
≥ 20	63	4.5	EI 45-U/C	
Composite pipes (C) with local insulation (D) – interrupted				
Insulation		Pipe		Classification
thickness (t_D) [mm]	length (L_D) [mm]	diameter (d_C) [mm]	wall thickness (t_C) [mm]	
20	≥ 250	63	4.5	EI 45-U/C
Bundle of 3 composite pipes (C) with continued insulation (D) wrapped around the bundle – interrupted				
Insulation thickness (t_D) [mm]	Pipe diameter (d_C) [mm]	Pipe wall thickness (t_C) [mm]	Classification	
≥ 20	32	3.0	EI 45-U/C	

Bundle of 3 composite pipes (C) with local insulation (D) wrapped around the bundle – interrupted				
Insulation		Pipe		Classification
thickness (t_D) [mm]	length (L_D) [mm]	diameter (d_C) [mm]	wall thickness (t_C) [mm]	
20	≥ 250	32	3.0	EI 45-U/C

C.3 Rigid floors according to 1.2.1 e), minimum thickness 150 mm

Penetration seal:

50 mm Hilti Firestop Board CFS-CT B 2S (A_1) or a mineral wool board according to Table D.1 coated with Hilti Firestop Coating CFS-CT (A_1), dry thickness of coating 0.7 mm on both sides, all cut edges of boards sealed with Hilti Firestop Acrylic Sealant CFS-S ACR, remaining gaps around cables / cable supports (trays, ladders etc.) and other services filled with Hilti Firestop Acrylic Sealant CFS-S ACR.

The board may be positioned flush to the surface of the building element or in any position within the building element.

Maximum distance for 1st service support: 100 mm.

Maximum seal size: see figure below

Minimum distances in mm (for illustration see C.1):

$s_1 = 0$ (distance between cables/cable supports and seal edge)

$s_2 = 0$ (distance between cable supports)

$s_3 = 0$ (distance between cables and upper seal edge)

$s_4 = 0$ (distance between cable supports and bottom seal edge)

$s_6 = 45$ (distance between metal pipes and seal edge)

$s_8 = 20$ (distance between metal pipes)


$s_9 = 74$ (distance between plastic pipes/pipe closure devices and seal edge)

$s_{11} = 0$ (distance between plastic pipes/pipe closure devices)

$s_{12} = 50$ (distance between metal pipes and plastic pipes/pipe closure devices)





$s_{13} = 46$ (distance between cables/cable supports and metal pipes)

$s_{14} = 32$ (distance between cables/cable supports and plastic pipes/pipe closure devices)

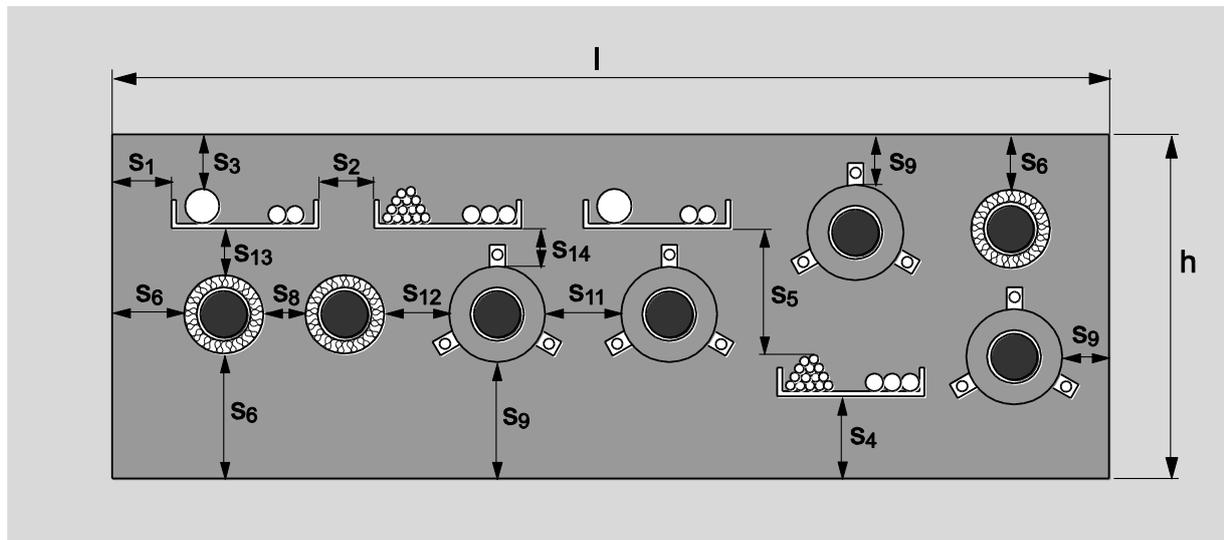

C.3.2 Cables

Construction details (for symbols and abbreviations see Annex A.3):

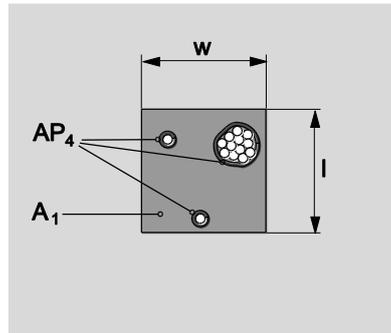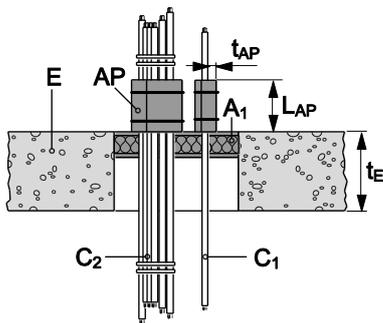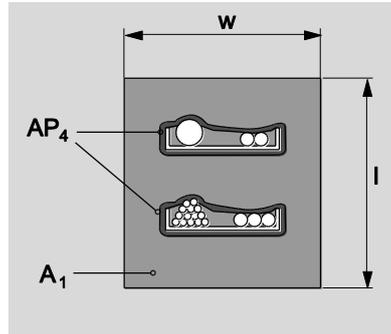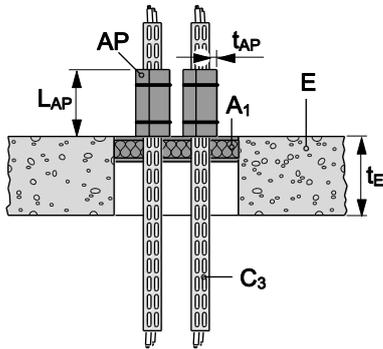

	Classification
Additional protection according to 1.1.2.5:	AP ₃ / AP ₄
All sheathed cable types currently and commonly used in building practice in Europe (e.g. power, control, signal, telecommunication, data, optical fibre cables, with or without cable supports, with a maximum diameter of 80 mm, with or without cable supports	EI 45
Non-sheathed cables (wires) currently and commonly used in building practice in Europe with a maximum diameter of 17 mm, with or without cable supports	EI 45
Non-sheathed cables (wires) currently and commonly used in building practice in Europe with a maximum diameter of 24 mm, with or without cable supports	EI 30
Tied cable bundle, maximum diameter 100 mm, maximum diameter of single cable 21 mm, with or without cable supports	EI 45


C.3.3 Small conduits and tubes

Construction details: see C.3.2	Classification
Additional protection according to 1.1.2.5:	AP ₃ / AP ₄
Ø ≤ 16 mm, wall thickness ≥ 1 mm, arranged linear, with or without cables, with or without cable supports	
Plastic conduits and tubes	EI 45 U/C
Steel conduits and tubes	EI 45 C/U


C.3.4 Metal pipes with mineral wool insulation according to Table D.3

Construction details (for symbols and abbreviations see Annex A.3):

Continued insulation, interrupted (CI)

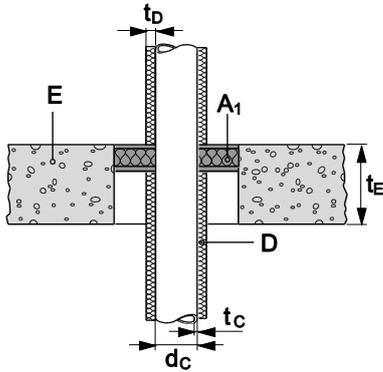

Local insulation, interrupted (LI)

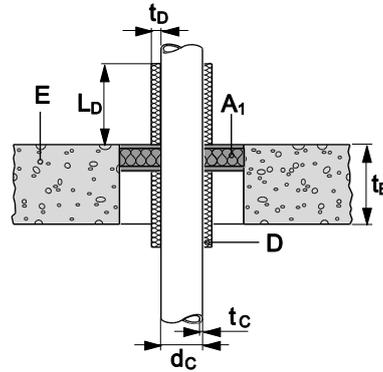**Steel pipes (C) with continued insulation (D) – interrupted**

Insulation thickness (t_D) [mm]	Pipe diameter (d_C) [mm]	Pipe wall thickness (t_C) [mm]	Classification
≥ 20	32	4.0 – 14.2	EI 45-C/U
≥ 30	32 – 114.3	3.6 – 14.2	EI 45-C/U

Steel pipes (C) with local insulation (D) – interrupted

Insulation		Pipe		Classification
thickness (t_D) [mm]	length (L_D) [mm]	diameter (d_C) [mm]	wall thickness (t_C) [mm]	
20	≥ 500	32	4.0 – 14.2	EI 45-C/U
30	≥ 500	114.3	3.6 – 14.2	EI 45-C/U

The field of application given above for steel pipes is also valid for other metal pipes with lower heat conductivity than unalloyed steel and a melting point of minimum 1050°C, e.g. cast iron, stainless steels, Ni alloys (NiCu, NiCr and NiMo alloys)

Copper pipes (C) with continued insulation (D) – interrupted

Insulation thickness (t_D) [mm]	Pipe diameter (d_C) [mm]	Pipe wall thickness (t_C) [mm]	Classification
≥ 20	42	1.5 – 14.2	EI 45-C/U

Copper pipes (C) with local insulation (D) – interrupted

Insulation		Pipe		Classification
thickness (t_D) [mm]	length (L_D) [mm]	diameter (d_C) [mm]	wall thickness (t_C) [mm]	
20	≥ 500	42	1.5 – 14.2	EI 45-C/U

The field of application given above for copper pipes is also valid for other metal pipes with lower heat conductivity than copper and a melting point of minimum 1100°C, e.g. cast iron, stainless steels, Ni alloys (NiCu, NiCr and NiMo alloys) and Ni.

C.3.5 Plastic pipes with Hilti Firestop Collar CFS-C				
<p>Construction details (for symbols and abbreviations see Annex A.3)</p> <p>Hilti Firestop Collars CFS-C are installed on the bottom side of the seal, fixed by threaded rods, washers and nuts as specified in Annex B.7.</p>				
PVC-U pipes (C) according to EN ISO 1452-2, EN ISO 15493 and DIN 8061/8062				
Pipe diameter d_c (mm)	Pipe wall thickness t_c (mm)	Collar size (A_1)	No. of hooks	Classification
32	1.8	CFS-C 50/1.5"	2	EI 45-U/C
110	2.2 – 8.2	CFS-C 110/4"	4	EI 45-U/C
The results are also valid for PVC-U pipes according EN 1329-1 ⁸ and EN 1453-1 ⁸ .				

ANNEX D**SPECIFICATION OF MINERAL WOOL BOARDS AND SPECIAL PIPES****Table D.1: Specification for mineral wool boards suitable for being used together with Hilti Firestop Coating CFS-CT**

Manufacturer	Product designation
Flumroc	Flumroc 341
Isover	Fireprotect 150
Isover	Protect BSP 150
Isover	Orsil Pyro
Isover	Orsil S
Isover	Orsil T
Isover	Stropoterm
Knauf	HERALAN BS-15
Knauf	HERALAN DDP-S
Knauf	HERALAN DP-15
Paroc	FPS 14
Paroc	FPS 17
Paroc	Pyrotech Slab 140
Paroc	Pyrotech Slab 160
Rockwool	Hardrock II
Rockwool	RP-XV
Rockwool	RPB-15

Table D.2: Specification for mineral wool products suitable for being used as additional protection for cables/cable supports according to 1.1.2.5

Characteristic	Specification	Unit
Stone wool according to EN 14303		
Reaction to fire class according to EN 13501-1	A1 or A2	-
Thermal conductivity at 20°C	≤ 0.040	W/(mK)
Density	35 - 45	kg/m ³
Surface	Al-foil faced on one side	-

The following list contains suitable products but may not be exhaustive:

Manufacturer	Product designation
Isover	Ultimate U TFA 34
Knauf	Lamella Forte LLMF AluR
Paroc	Lamella Mat 35 Alu Coat
Rockwool	Klimafix
Rockwool	Klimarock
Rockwool	Rockwool 133 (Lamella mat)

Table D.3: Specification for mineral wool products suitable for being used as pipe insulation

Interrupted insulation
Stone wool according to EN 14303, class A2 or A1 according to EN 13501-2, Al-faced

Sustained insulation	
Manufacturer	Product designation
Isover	Coquilla AT-LR
Isover	Protect BSR 90 alu
Paroc	Section AluCoat T
Rockwool	Conlit Pipe sections
Rockwool	Klimarock
Rockwool	RS 800 pipe sections

Table D.4: PE-X pipes according to EN ISO 15875

The following list contains suitable products but may not be exhaustive:

Manufacturer	Product designation
Uponor	Uponor PE-Xa pipes
Wirsbo (now Uponor)	Wirsbo PE-Xa pipes, Uponor Wirsbo PE-Xa pipes

Table D.5: PE-X pipe-in-pipe

Pipes according to Table D.4, delivered as pre-assembled pipe-in-pipe product or installed on site within ducting (protection pipe) made of PE-HD (high density polyethylene). The ducting or the outer pipe of the pipe-in-pipe product is a corrugated pipe. The key to the dimensions given in Annex C is given in the following example:

PE-X 12x2 + PE-HD 25/20:

Inner pipe made of PE-X, $\varnothing a = 12$ mm, $s = 2$ mm;

Ducting made of PE-HD, corrugated pipe with $\varnothing_{\max} = 25$ mm, $\varnothing_{\min} = 20$ mm