



**INSTYTUT TECHNIKI BUDOWLANEJ**  
PL 00-611 WARSZAWA  
ul. Filtrowa 1  
tel.: (+48 22) 825-04-71  
(+48 22) 825-76-55  
fax: (+48 22) 825-52-86  
www.itb.pl



Member of



## European Technical Assessment

**ETA-12/0572  
of 29/03/2019**

(English language translation – the original version is in Polish language)

### General Part

**Technical Assessment Body issuing the European Technical Assessment**

Instytut Techniki Budowlanej

**Trade name of the construction product**

S-PKK, S-PCK, S-SP, S-SPM

**Product family to which the construction product belongs**

Nailed-in plastic anchors for fixing of external thermal insulation composite systems with rendering in concrete and masonry

**Manufacturer**

pgb-Polska Sp. z o.o.  
ul. F. W. Redena 3  
PL 41-807 Zabrze, Poland

**Manufacturing plant**

pgb-Polska Sp. z o.o.  
ul. F. W. Redena 3  
PL 41-807 Zabrze, Poland

**This European Technical Assessment contains**

15 pages including 3 Annexes which form an integral part of this Assessment

**This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of**

European Assessment Document EAD 330196-01-0604 "Plastic anchors made of virgin or non-virgin material for fixing of external thermal insulation composite systems with rendering"

**This version replaces**

ETA-12/0572 issued on 29/12/2017

*This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.*

*Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.*

## Specific Part

### 1 Technical description of the product

The S-PKK, S-PCK, S-SP and S-SPM nailed-in plastic anchors consists of a plastic expansion sleeve with a collar and a steel nail as an expansion pin. The anchor sleeve is made of polyamide PA6 (virgin material). The nail is made of galvanized steel or stainless steel. The plastic anchor sleeve is expanded by hammering the nail, which will press the sleeve against the wall of the drilled hole.

The S-PKK anchor consists of a plastic expansion sleeve with a countersunk collar and a countersunk head nail.

The S-PCK anchor consists of a plastic expansion sleeve with a cylindrical collar and a countersunk head nail.

The S-SP anchor consists of a plastic expansion sleeve with a spherical collar and a countersunk head nail.

The S-SPM anchor consists of a plastic expansion sleeve with a countersunk collar and a nail with metric thread end.

The illustration and the description of the products are given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Annex C are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Performance of the product

##### 3.1.1 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance	Annex C1
Displacements	Annex C1
Edge distances and spacings	Annex B2

##### 3.1.2 Energy economy and heat retention (BWR 6)

No performance assessed.

#### 3.2 Methods used for the assessment

The assessment of the products has been made in accordance with the EAD 330196-01-0604 "Plastic anchors made of virgin or non-virgin material for fixing of external thermal insulation composite systems with rendering".

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**


According to the Decision 97/463/EC of the European Commission the system 2+ of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) applies.

**5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited in Instytut Techniki Budowlanej.

For the type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 29/03/2019 by Instytut Techniki Budowlanej



Anna Panek, MSc  
Deputy Director of ITB

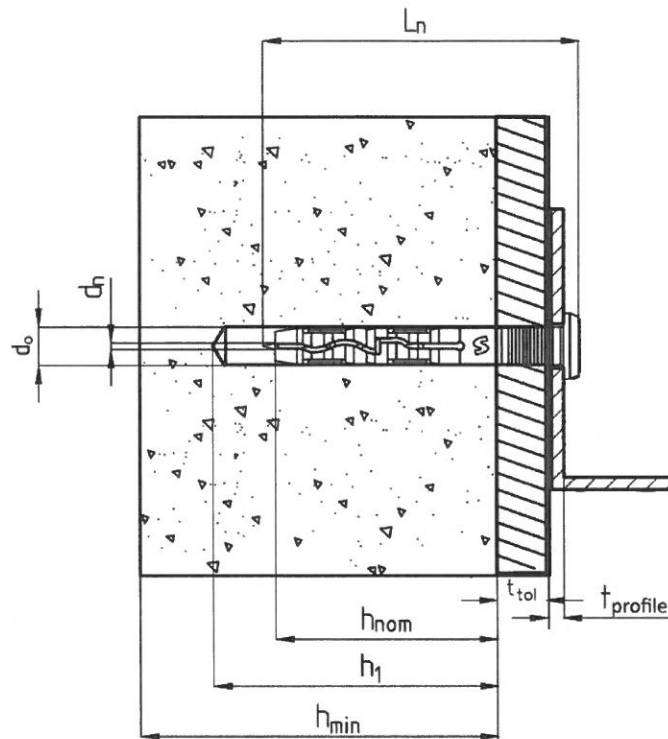

**Intended Use**

Multiple fixing of profiles for ETICS or VETURE Kits


**Legend**

- $d_0$  = nominal diameter of drill bit
- $h_1$  = depth of drill hole
- $h_{nom}$  = embedment depth
- $d_n$  = nominal diameter of the nail
- $L_n$  = total length of the nail
- $h_{min}$  = minimum thickness of the concrete member
- $t_{tol}$  = thickness of the equalizing layer and/or non load bearing coating
- $t_{profile}$  = thickness of profile
- $t_{fix}$  = thickness of fixture ( $t_{tol} + t_{profile}$ )

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Installation conditions

**Annex A1**  
of European  
Technical Assessment  
ETA-12/0572

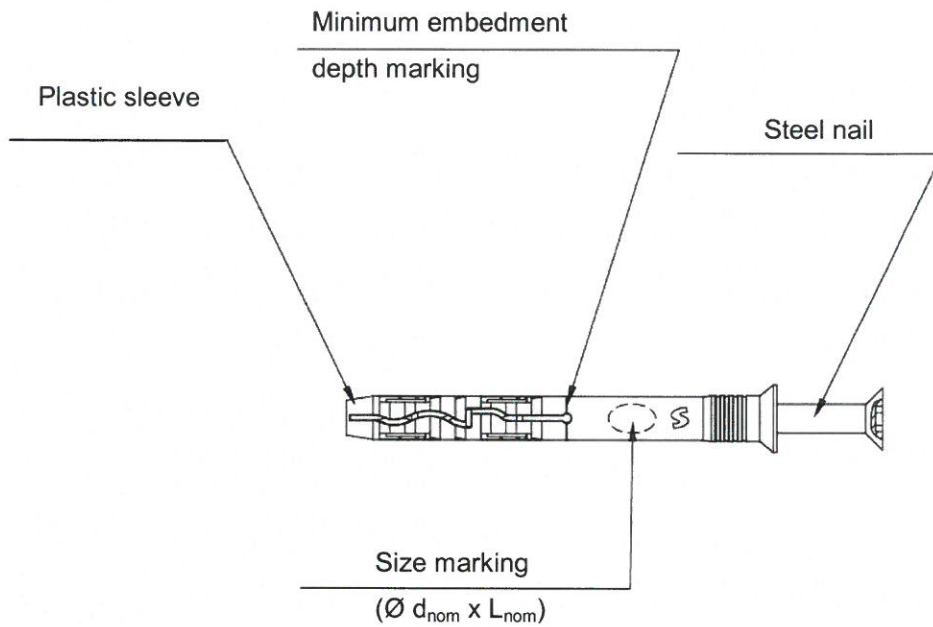


**Table A1:** Anchor types

Type	Description	Drawing
S-PKK	Countersunk head sleeve + countersunk head nail	
S-PCK	Cylindrical head sleeve + countersunk head nail	
S-SP	Spherical head sleeve + countersunk head nail	
S-SPM	Countersunk head sleeve + metric thread head nail	

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Anchor types

**Annex A2**  
of European  
Technical Assessment  
ETA-12/0572

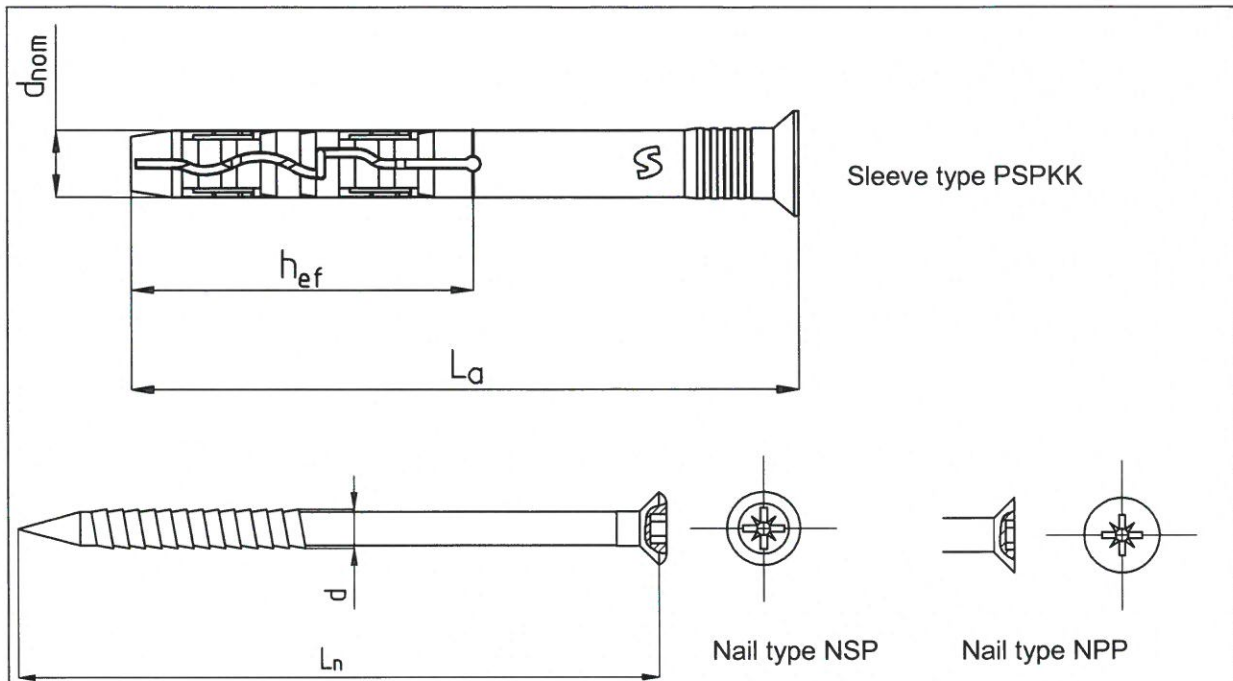


**Table A2: S-PKK anchor types and dimensions [mm]**

Anchor type	Anchor sleeve			Nail	
	$d_{nom}$	$L_a$	$h_{ef}$	$d$	$L_n$
S-PKK / 5 x 30	5	30	25	3,5	35
S-PKK / 5 x 40	5	40	25	3,5	45
S-PKK / 5 x 50	5	50	25	3,5	55
S-PKK / 6 x 40	6	40	30	3,9	45
S-PKK / 6 x 50	6	50	30	3,9	55
S-PKK / 6 x 60	6	60	30	3,9	65
S-PKK / 6 x 80	6	80	30	3,9	85
S-PKK / 8 x 45	8	45	40	4,9	50
S-PKK / 8 x 60	8	60	40	4,9	65
S-PKK / 8 x 80	8	80	40	4,9	85
S-PKK / 8 x 100	8	100	40	4,9	105
S-PKK / 8 x 120	8	120	40	4,9	125
S-PKK / 8 x 140	8	140	40	4,9	145
S-PKK / 10 x 80	10	80	50	6,9	85
S-PKK / 10 x 100	10	100	50	6,9	105
S-PKK / 10 x 120	10	120	50	6,9	125
S-PKK / 10 x 140	10	140	50	6,9	145
S-PKK / 10 x 160	10	160	50	6,9	165

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Dimensions of the S-PKK anchors elements

**Annex A3**  
of European  
Technical Assessment  
ETA-12/0572

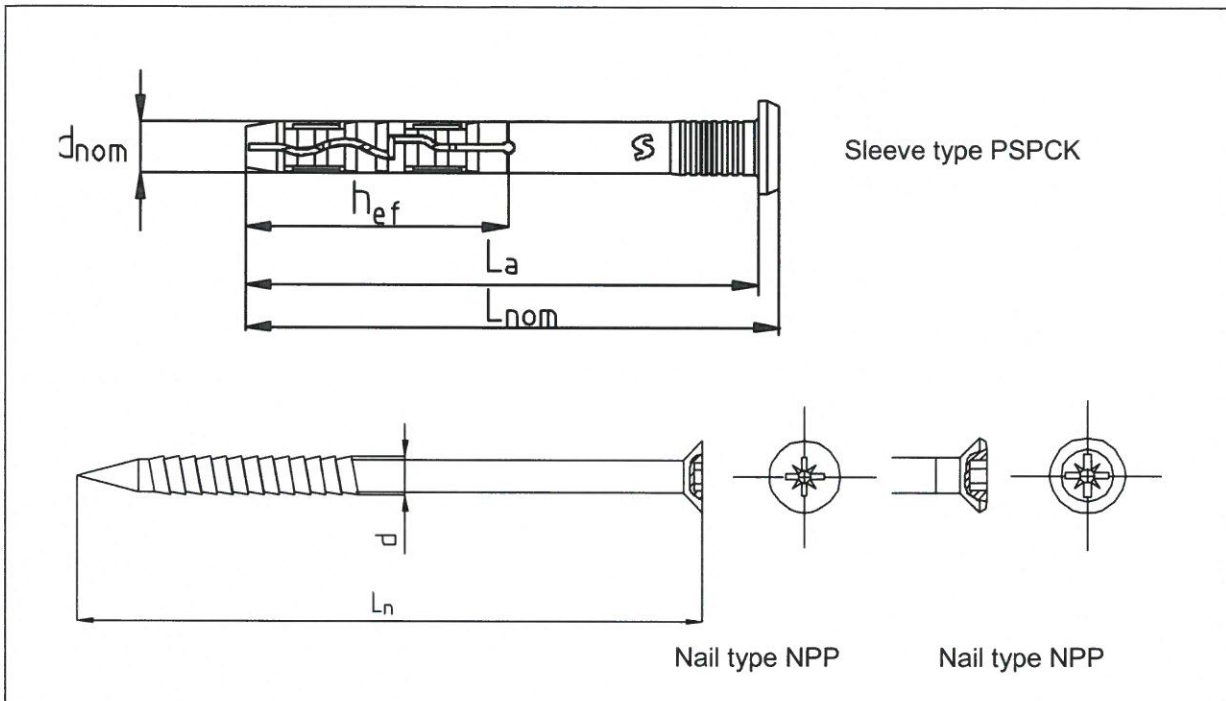

**Table A3:** S-PCK anchor types and dimensions [mm]


Anchor type	Anchor sleeve				Nail	
	$d_{nom}$	$L_{nom}$	$L_a$	$h_{ef}$	$d$	$L_n$
S-PCK / 5 x 30	5	31	29	25	3,5	35
S-PCK / 5 x 40	5	43	40	25	3,5	45
S-PCK / 5 x 50	5	51	49	25	3,5	55
S-PCK / 6 x 35	6	35	32	30	3,9	40
S-PCK / 6 x 40	6	43	40	30	3,9	45
S-PCK / 6 x 60	6	63	60	30	3,9	65
S-PCK / 6 x 80	6	83	80	30	3,9	85
S-PCK / 8 x 60	8	63	60	40	4,9	65
S-PCK / 8 x 80	8	83	80	40	4,9	85
S-PCK / 8 x 100	8	102	98	40	4,9	105
S-PCK / 8 x 120	8	122	118	40	4,9	125
S-PCK / 8 x 140	8	142	138	40	4,9	145

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Dimensions of the S-PCK anchors elements

**Annex A4**  
of European  
Technical Assessment  
ETA-12/0572



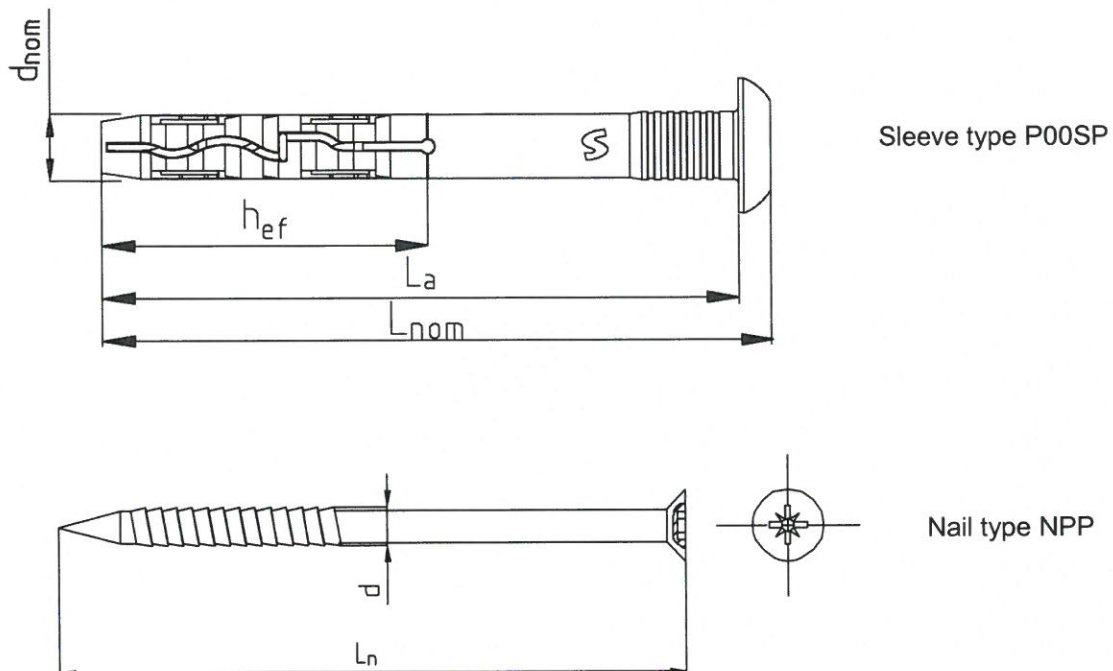


**Table A4:** S-SP anchor types and dimensions [mm]

Anchor type	Anchor sleeve				Nail	
	$d_{nom}$	$L_{nom}$	$L_a$	$h_{ef}$	$d$	$L_n$
S-SP / 6 x 40	6	41	38	30	3,9	50
S-SP / 6 x 60	6	61	58	30	3,9	70
S-SP / 6 x 80	6	81	78	30	3,9	85

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Dimensions of the S-SP anchors elements

**Annex A5**  
of European  
Technical Assessment  
ETA-12/0572

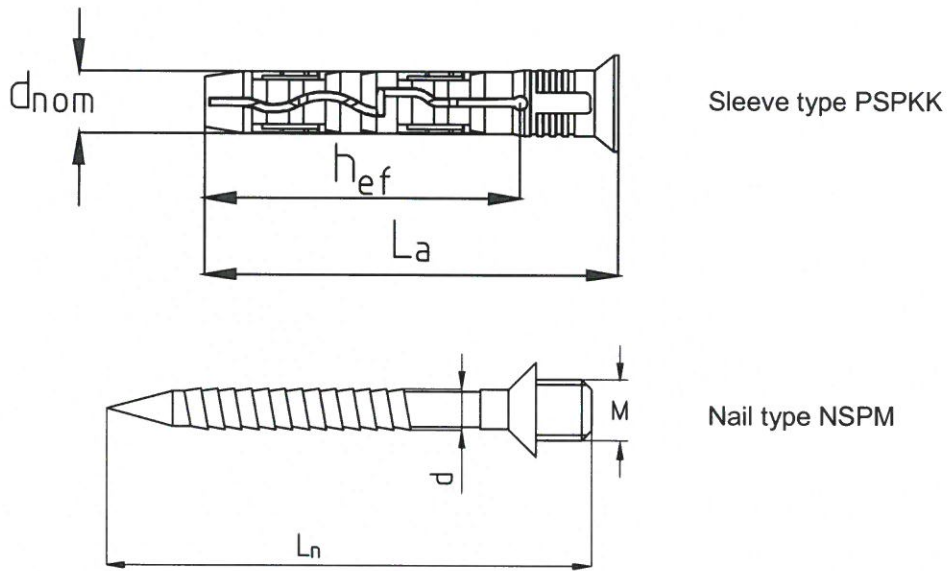

**Table A5: S-SPM anchor types and dimensions [mm]**

Anchor type	Anchor sleeve			Nail		
	$d_{nom}$	$L_a$	$h_{ef}$	$d$	$L_n$	$M$
S-SPM / M6	6	40	30	3,9	50	6
S-SPM / M7	6	40	30	3,9	50	7
S-SPM / M8	8	45	40	4,9	50	8

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Dimensions of the S-SPM anchors elements

**Annex A6**  
of European  
Technical Assessment  
ETA-12/0572

**Table A6: Materials**

<b>Designation</b>	<b>Material</b>
Anchor sleeve	Polyamide PA6, light grey, virgin material
Expansion pin (nail) made of carbon steel	Carbon steel: tensile strength $f_{u,k} \geq 420$ MPa and tensile yield strength $f_{y,k} \geq 320$ MPa <ul style="list-style-type: none"> <li>▪ Zinc plating <math>\geq 5</math> <math>\mu\text{m}</math>; electroplated acc. to EN ISO 4042</li> <li>▪ Non-electrolytically applied zinc flake coatings <math>\geq 5</math> <math>\mu\text{m}</math> acc. to EN ISO 10683</li> </ul>
Expansion pin (nail) made of stainless steel	Stainless steel grade 1.4301, 1.4306, 1.4307 (AISI 304) or 1.4401, 1.4404, 1.4571 (AISI 316) according to EN 10088 Tensile strength $f_{u,k} \geq 600$ MPa and tensile yield strength $f_{y,k} \geq 360$ MPa

**S-PKK, S-PCK, S-SP, S-SPM**

**Product description**  
Materials

**Annex A7**  
of European  
Technical Assessment  
ETA-12/0572

**Specification of intended use**

**Anchorage subject to:**

- Wind suction loads.  
 Note: The anchor shall not be used for the transmission of dead loads of the external thermal insulation composite system.

**Base materials:**

- Reinforced or unreinforced normal weight concrete (use category A), according to Annex C1.
- Solid masonry (use category B), according to Annex C1.
- For other base materials of the use category A and B the characteristic resistance of the anchor may be determined by job site tests according to EOTA Technical Report TR 051, edition December 2016.

**Temperature range:**

- 0°C to +40°C (max. short term temperature +40°C and max. long term temperature +24°C).

**Design:**

- The anchorages are designed under the responsibility of an engineer experiences in anchorages and masonry work with the partial safety factors  $\gamma_M = 2,0$  and  $\gamma_F = 1,5$ , if there are no other national regulations.
- Verifiable calculation notes and drawings with anchor positions are prepared taking into account of the loads to be anchored.
- Fasteners are only to be used for multiple fixing of profiles ETICS or VETURE Kits, according to EAD 330196-01-0604, fig. 1.3.

**Installation:**

- Hole shall be drilled by using a hammer drill.
- Anchor installation shall be carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Installation shall be executed in temperature from 0°C to +40°C.
- Exposure to UV due to solar radiation of the anchor not protected by rendering shall not exceed 6 weeks.

<b>S-PKK, S-PCK, S-SP, S-SPM</b>	<b>Annex B1</b> of European Technical Assessment ETA-12/0572
<b>Intended use</b> Specifications	


**Table B1:** Installation characteristics

Anchor diameter		Ø5	Ø6	Ø8	Ø10
Nominal diameter of drill bit	$d_{nom}$ [mm]	5,0	6,0	8,0	10,0
Cutting diameter of drill bit	$d_{cut}$ [mm]	≤ 5,40	≤ 6,40	≤ 8,45	≤ 10,45
Depth of drill hole	$h_1$ [mm]	≥ 35	≥ 40	≥ 50	≥ 60
Effective anchorage depth	$h_{ef}$ [mm]	≥ 25	≥ 30	≥ 40	≥ 50

**Table B2:** Minimum thickness of base material, anchor spacing and edge distance

Minimum thickness of base material	$h_{min}$ [mm]	100
Minimum spacing	$s_{min}$ [mm]	100
Minimum edge distance	$c_{min}$ [mm]	100

Diagram of spacing

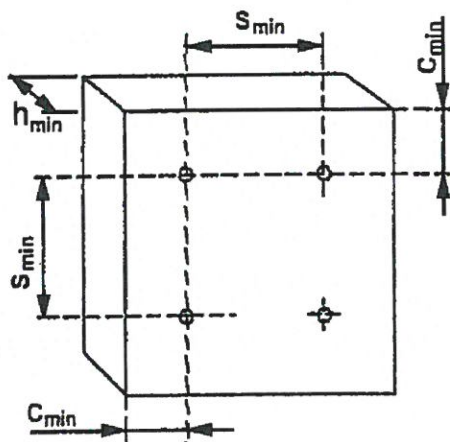

**S-PKK, S-PCK, S-SP, S-SPM**



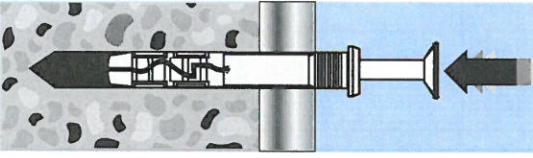
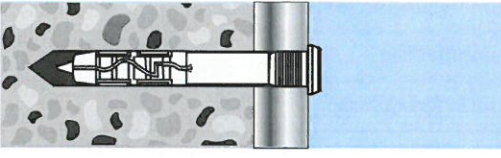
**Intended use**

Installation characteristics, minimum thickness of base material, anchor spacing and edge distance

**Annex B2**

of European  
Technical Assessment  
ETA-12/0572

**Installation instruction**

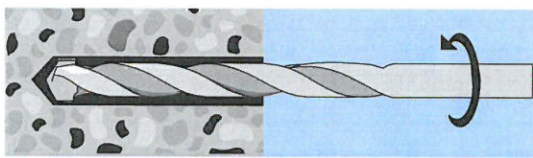 <p>1. Drill the hole by means of hammer drilling. Drill perpendicular.</p>	 <p>2. Clean the drill hole.</p>
 <p>3. Nail-in the expansion pin by means of a hammer.</p>	 <p>4. Correctly installed anchor.</p>

**S-PKK, S-PCK, S-SP, S-SPM**

**Intended use**  
Installation instruction

**Annex B3**  
of European  
Technical Assessment  
ETA-12/0572

**Table C1:** Characteristic resistance to tension loads  $N_{Rk}$  [kN] for single anchor

Base material	Referring standard	$N_{Rk}$ [kN]			
		$\emptyset 5$	$\emptyset 6$	$\emptyset 8$	$\emptyset 10$
Concrete C12/15	EN 206	0,45	0,55	0,65	1,40
Concrete C20/25 + C50/60	EN 206	0,65	0,80	1,50	1,50
Clay bricks MZ	EN 771-1	0,70	0,75	0,80	1,50
Calcium silicate bricks KS	EN 771-2	0,70	0,70	0,80	1,50
Partial safety factor for anchor resistance, $\gamma_M$ <sup>1)</sup>	2,0				
<sup>1)</sup> Valid in the absence of national regulations					

**Table C2:** Displacements behaviour

Base material	$\frac{N_{Rk}}{3}$ [kN]				$\delta \left( \frac{N_{Rk}}{3} \right)$ [mm]			
	$\emptyset 5$	$\emptyset 6$	$\emptyset 8$	$\emptyset 10$	$\emptyset 5$	$\emptyset 6$	$\emptyset 8$	$\emptyset 10$
Concrete C12/15	0,15	0,18	0,22	0,47	0,23	0,21	0,11	0,36
Concrete C20/25 + C50/60	0,22	0,27	0,50	0,50	0,33	0,30	0,26	0,39
Clay bricks MZ	0,23	0,25	0,27	0,50	0,37	0,23	0,68	0,20
Calcium silicate bricks KS	0,23	0,23	0,27	0,50	0,26	0,32	0,61	0,56

**S-PKK, S-PCK, S-SP, S-SPM**

**Performances**  
Characteristic resistance and displacements

**Annex C1**  
of European  
Technical Assessment  
ETA-12/0572

