


Centre Scientifique et Technique du Bâtiment

84 avenue Jean Jaurès
CHAMPS-SUR-MARNE
F-77447 Marne-la-Vallée Cedex 2
Tel. : (33) 01 64 68 82 82
Fax : (33) 01 60 05 70 37

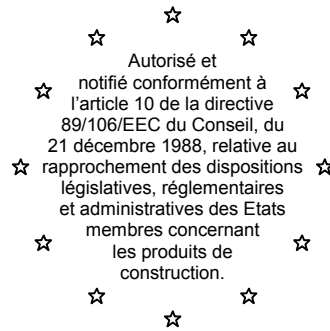

CSTB
le futur en construction

MEMBRE DE L'EOTA

European Technical Approval

ETA-06/0032

(English language translation, the original version is in French language)

Nom commercial :

Trade name:

SPIT HIT M

Titulaire :

Holder of approval:

Société SPIT

Route de Lyon

F-26501 BOURG-LES-VALENCE

France

Type générique et utilisation prévue du produit de construction :

Generic type and use of construction product:

Cheville à clou pour fixation de système composite d'isolation thermique extérieure dans le béton et la maçonnerie

Nailed-in anchor for fixing of external insulation composite systems with rendering in concrete and masonry

Validité du :
au :

Validity from / to:

28/06/2013

05/12/2016

Usine de fabrication :

Manufacturing plant:

Société SPIT

Route de Lyon

F-26501 BOURG-LES-VALENCE

France

Le présent Agrément technique européen contient :

This European Technical Approval contains:

13 pages incluant 5 annexes faisant partie intégrante du document.

13 pages including 5 annexes which form an integral part of the document.

Cet Agrément Technique Européen remplace l'Agrément ETA-06/0032 valide du 05/12/2011 au 05/12/2016
This European Technical Approval replaces ETA-06/0032 with validity from 05/12/2011 to 05/12/2016



Organisation pour l'Agrément Technique Européen
European Organisation for Technical Approvals

I LEGAL BASES AND GENERAL CONDITIONS

1. This European Technical Approval is issued by the Centre Scientifique et Technique du Bâtiment in accordance with:
 - Council Directive 89/106/EEC of 21 December 1988 on the approximation of laws, regulations and administrative provisions of Member States relating to construction products¹, modified by the Council Directive 93/68/EEC of 22 July 1993²;
 - Décret n° 92-647 du 8 juillet 1992³ concernant l'aptitude à l'usage des produits de construction;
 - Common Procedural Rules for Requesting, Preparing and the Granting of European Technical Approvals set out in the Annex of Commission Decision 94/23/EC⁴;
 - Guideline for European Technical Approval of « Plastic anchors for fixing of external thermal insulation composite systems with rendering » ETAG 014, edition January 2002.
2. The Centre Scientifique et Technique du Bâtiment is authorised to check whether the provisions of this European Technical Approval are met. Checking may take place in the manufacturing plant (for example concerning the fulfilment of assumptions made in this European Technical Approval with regard to manufacturing). Nevertheless, the responsibility for the conformity of the products with the European Technical Approval and for their fitness for the intended use remains with the holder of the European Technical Approval.
3. This European Technical Approval is not to be transferred to manufacturers or agents of manufacturer other than those indicated on page 1; or manufacturing plants other than those indicated on page 1 of this European Technical Approval.
4. This European Technical Approval may be withdrawn by the Centre Scientifique et Technique du Bâtiment pursuant to Article 5 (1) of the Council Directive 89/106/EEC.
5. Reproduction of this European Technical Approval including transmission by electronic means shall be in full. However, partial reproduction can be made with the written consent of the Centre Scientifique et Technique du Bâtiment. In this case partial reproduction has to be designated as such. Texts and drawings of advertising brochures shall not contradict or misuse the European Technical Approval.
6. The European Technical Approval is issued by the approval body in its official language. This version corresponds to the version circulated within EOTA. Translations into other languages have to be designated as such.

¹ Official Journal of the European Communities n° L 40, 11.2.1989, p. 12

² Official Journal of the European Communities n° L 220, 30.8.1993, p. 1

³ Journal officiel de la République française du 14 juillet 1992

⁴ Official Journal of the European Communities n° L 17, 20.1.1994, p. 34

II SPECIFIC CONDITIONS OF THE EUROPEAN TECHNICAL APPROVAL

1 Definition of product and intended use

1.1. Definition of product

The SPIT HIT M anchor consists of a plastic expansion sleeve with a collar for fixing the profiles for thermal insulation systems and a metallic nail as an expansion element. The anchor sleeve is made of polyamide 6 (PA6) and the nail is made of bi-chromate steel or stainless steel. The collar exists in two different shapes as well as the nail head. The plastic sleeve is expanded by hammering in the expansion element (except for long size anchors with diameter 8 mm and broad pansunk head for which expansion is achieved by screwing) which presses the sleeve against the wall of the drilled hole.

The installed anchor is shown in Annex 1.

1.2. Intended use

The anchor is intended to be used for anchorages for which requirements for safety in use in the sense of the Essential Requirement 4 of Council Directive 89/106/EEC shall be fulfilled and failure of anchorages made with these products would cause low risk to human life. The anchor is to be used only as multiple fixing for the anchorage of profiles for bonded thermal insulation composite system (ETICS) according to ETAG 014 in concrete and masonry. The base material shall consist of reinforced or unreinforced normal weight concrete of strength class C 12/15 at least to C50/60 at most according to EN 206-1 and of masonry walls according to Table 4 of Annex 4.

The anchor may only be used for transmission of wind suction loads and shall not be used for the transmission of dead loads of the thermal insulation composite system. The dead loads have to be transmitted by the adhesion of the thermal insulation composite system. The anchor with the be-chromated steel nail shall be used with a thermal insulation cover of at least 50 mm.

The provisions made in this European Technical Approval are based on an assumed intended working life of the anchor of 25 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

2 Characteristics of product and methods of verification

2.1. Characteristics of product

The anchor corresponds to the drawings and provisions given in Annex 2. The characteristic material values, dimensions and tolerances of the anchor not indicated in Annexes 1 to 3 shall correspond to the respective values laid down in the technical documentation⁵ of this European Technical Approval. The characteristic anchor values for the design of anchorages are given in Annex 5.

Each plastic expansion sleeve is marked with the trade name "HIT M" and with the letter S for "SPIT", the diameter and maximum thickness of fixture: e.g. S 6-25.

The anchor shall only be packaged and supplied as a complete unit.

⁵ The technical documentation of this European Technical Approval is deposited at the Centre Scientifique et Technique du Bâtiment and, as far as relevant for the tasks of the approved bodies involved in the attestation of conformity procedure, is handed over to the approved bodies.

2.2. Methods of verification

The assessment of fitness of the anchor for the intended use in relation to the requirements for safety in use in the sense of the Essential Requirement 4 has been made in accordance with the « Guideline for European Technical Approval of Plastic Anchors for fixing of External Thermal Insulation Composite Systems with rendering » based on the use categories A, B and C.

3 Evaluation of Conformity and CE marking

3.1. Attestation of conformity system

The system of attestation of conformity 2 (ii) (referred to as system 2+) according to Council Directive 89/106/EEC Annex III laid down by the European Commission provides:

a) tasks for the manufacturer:

1. initial type testing of the product,
2. factory production control,
3. testing of samples taken at the factory by the manufacturer in accordance with a prescribed test plan.

b) tasks for the approved body:

4. certification of the factory production control on the basis of ,
 - initial inspection of the factory and of factory production control,
 - continuous surveillance, assessment and approval of factory production control.

3.2. Responsibilities

3.2.1. Tasks of the manufacturer, factory production control

The manufacturer has a factory production control system in the plant and exercises permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer are documented in a systematic manner in the form of written policies and procedures. This production control system ensures that the product is in conformity with the European Technical Approval.

The manufacturer shall only use raw materials supplied with the relevant inspection documents as laid down in the prescribed test plan⁶. The incoming raw materials shall be subject to controls and tests by the manufacturer before acceptance. Check of incoming materials shall include control of the inspection documents presented by suppliers (comparison with nominal values) by verifying the dimensions and determining the material properties.

The manufactured components of the anchor shall be subjected to the following tests:

- Nail:
 - Mechanical properties (yield and ultimate tensile strength, ultimate elongation)
- Expansion sleeve:
 - Physical properties (diameter, length, density)
 - Mechanical properties (yield and ultimate tensile strength, ultimate elongation)
 - Thermal properties (Melting flow index, DSC curves)
- Visual control of both parts of the anchor (nail and expansion sleeve).
- Adjusting data of injection moulding machine.

The frequency of controls and tests conducted during production is laid down in the prescribed test plan taking account of the automated manufacturing process of the anchor.

The results of factory production control are recorded and evaluated. The records include at least the following information:

⁶

The prescribed test plan has been deposited at the Centre Scientifique et Technique du Bâtiment and is only made available to the approved bodies involved in the conformity attestation procedure.

- designation of the product, basic material and components;
- type of control or testing;
- date of manufacture of the product and date of testing of the product or basic material and components;
- result of control and testing and, if appropriate, comparison with requirements;
- signature of person responsible for factory production control.

The records shall be presented to the inspection body during the continuous surveillance. On request, they shall be presented to the Centre Scientifique et Technique du Bâtiment.

Details of the extent, nature and frequency of testing and controls to be performed within the factory production control shall correspond to the prescribed test plan which is part of the technical documentation of this European Technical Approval.

3.2.2. Tasks of approved bodies

3.2.2.1. Initial inspection of the factory and of factory production control

The approved body shall ascertain that, in accordance with the prescribed tests plan, the factory, in particular the staff and equipment, and the factory production control are suitable to ensure a continuous and orderly manufacturing of the anchor with the specifications mentioned in 2.1 as well as in the Annexes to the European technical Approval.

3.2.2.2. Continuous surveillance

The approved body shall visit the factory at least once a year for surveillance. It has to be verified that the system of factory production control and the specified automated manufacturing process are maintained taking account of the prescribed test plan.

Continuous surveillance and assessment of factory production control have to be performed according to the prescribed test plan.

The results of product certification and continuous surveillance shall be made available on demand by the certification body or inspection body, respectively, to the Centre Scientifique et Technique du Bâtiment. In cases where the provisions of the European Technical Approval and the prescribed test plan are no longer fulfilled the conformity certificate shall be withdrawn.

3.3. CE-Marking

The CE marking shall be affixed on each packaging of anchors. The CE marking consists of the letters “CE” followed by the identification number of the inspection body. The CE-marking shall be accompanied by:

- name or identifying mark of the producer and manufacturing plant;
- the last two digits of the year in which the CE-marking was affixed;
- number of the European Technical Approval;
- use categories A, B and C.

- the name or identifying mark of the producer and manufacturing plant,
- the last two digits of the year in which the CE marking was affixed,
- the number of the EC certificate for the factory production control,
- the number of the European Technical Approval,
- the number of the relevant part of the ETAG Plastic Anchor for use in concrete and masonry
- use categories a, b and c.

4 Assumptions under which the fitness of the product for the intended use was favourably assessed

4.1. Manufacturing

The anchor is manufactured in accordance with the provisions of the European Technical Approval using the automated manufacturing process as identified during inspection of the plant by the Centre Scientifique et Technique du Bâtiment and the approved body and laid down in the technical documentation.

4.2. Installation

4.2.1. Design of anchorages

4.2.1.1 General

The ETA only applies to the manufacture and use of the anchor. Verification of stability of the external thermal insulation composite system including application of loads on the anchor are not subject of this European Technical Approval.

Fitness of the anchor for the intended use is given under the following provisions:

The design is carried out in compliance with ETAG 014 "Guideline for European Technical Approval of plastic anchors for fixing of External Thermal Insulation Composite Systems with rendering" under the responsibility of an engineer experienced in anchorages.

Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials, the thickness of the insulation and the dimensions of the anchorage members as well of the relevant tolerances.

Proof of direct local application of load on the base material has been delivered.

The anchor shall only be used for the transmission of wind suction loads. All other loads such as dead load and restraints shall be transmitted by the adhesion of the relevant external thermal insulation composite system.

4.2.1.2 Resistance

The characteristic values of the tension resistance of the anchor are given in Table 5, Annex 5. If there is a difference in the characteristic values of the base material or a similar base material of category B and C is supposed to be used, job-site tests according to 4.2.3 shall be carried out in order to determine the specific characteristic tension resistance.

4.2.1.3 Characteristic values, spacing and dimensions of anchorage member

The minimum spacing and dimensions of anchorage member according to Annex 5 shall be observed.

4.2.1.4 Displacement behaviour

When loaded to the design value of resistance in normal weight concrete a displacement of approximately 0,2 mm in the load direction is expected. When loaded to the design value of resistance in masonry made of clay bricks, aggregates concrete solid masonry units, aggregates concrete hollow masonry units and horizontally perforated clay bricks, a displacement from 0,1 mm to 0,3 mm in the load direction is expected.

4.2.2 Installation of anchor

The fitness for use of the anchor can only be assumed if the following conditions of installation are met:

- anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on the site;
- use of the anchor only as supplied by the manufacturer without exchanging the components of an anchor;

- anchor installation in accordance with the manufacturer's specifications and drawings prepared for that purpose and using the appropriate tools;
- checks before placing the anchor to ensure that the characteristic values of the base material in which the anchor is to be placed is identical with the values which the characteristic loads apply for;
- observation of the drilling method : in the case of horizontally perforated clay bricks, the drilled hole is carried out using a rotary drill. In the case of other base materials covered in this Approval, the drilled hole is carried out using hammer or impact drilling;
- placing drilled holes without damaging the reinforcement;
- temperature during the installation of the anchor $\geq 0^{\circ}\text{C}$;
- exposure to UV due to solar radiation of the anchor not protected by rendering ≤ 6 weeks.

4.2.3. Job site tests

The characteristic tension resistance of the anchor may be determined by means of job site pull-out tests carried out on the material actually used if a characteristic resistance of the base material does not exist.

The characteristic resistance of the anchor shall be determined by carrying out at least 15 centric tension load pull-out tests on the site. These tests are also possible under the same conditions in laboratory.

Execution and evaluation of the tests as well as the issuing of the test report and the determination of the characteristic resistance should be under the responsibility of approved testing laboratories or the supervision of the person responsible for the execution of the works on site.

Number and position of the anchors to be tested shall be adapted to the relevant special conditions of the site and, for example, to be increased in the case of hidden and larger areas, such that reliable information about the characteristic resistance of the anchor in the base material in question can be derived. The tests shall take into account the most unfavourable conditions of the practical execution.

4.2.3.1 Assembly

The anchor to be tested shall be installed (e.g. preparation of drilled hole, drilling tool to be used, drill bit) and the spacing and the edge distances shall be in the same way as planned for the fixing of the external thermal insulation composite system.

4.2.3.2 Execution of tests

The test rig used for the pull-out tests shall provide a continuous slow increase of the load, controlled by a calibrated load cell. The load shall apply perpendicular to the surface of the base material and shall be transmitted to the anchor via a hinge. The reaction forces shall be transmitted into the base material at a distance of at least 15 cm from the anchor. The load shall be increased continuously in a way that the ultimate load is reached after about 1 minute. The load is measured when the ultimate load (N_1) is achieved.

4.2.3.3 Test report

The test report shall include all information necessary to assess the resistance of the tested anchor. It shall be included in the construction dossier.

The minimum data required are:

- Construction site, date and location of the tests, air temperature, type ETICS to be fixed;
- Test requester;
- Masonry type (type of brick, strength class, dimensions, mortar group);
- Plastic anchor and nail used for the tests; Effective cutting diameter of drill bit;
- Test rig; Results of tests with ultimate value N_1 ;
- Test carried out or supervised by signature;

4.2.3.4 Evaluation of tests results

The characteristic resistance N_{Rk1} is obtained from the measured values N_1 as follows:

$$N_{Rk1} = 0,6 \cdot N_1 \leq 1,5 \text{ kN}$$

With N_1 the mean value of the five smallest measured values at the ultimate load.

4.2.4. Responsibility of the manufacturer

It is the responsibility of the manufacturer to ensure that the information on the specific conditions according to 1 and 2 including Annexes referred to in 4.2.1, 4.2.2 is given to those who are concerned. This information may be made by reproduction of the respective parts of the European Technical Approval. In addition, all installation data shall be shown clearly on the packaging and/or on an enclosed instruction sheet, preferably using illustrations.

The minimum data required are:

- base material for the intended use;
- drill bit diameter;
- maximum thickness of the ETICS;
- minimum effective anchorage depth;
- minimum hole depth;
- information on the installation procedure;
- identification of the manufacturing batch.

All data shall be presented in a clear and explicit form.

5 Recommendations on packaging, transport and storage.


The anchor shall be supplied as a complete unit.

The anchor shall be stored under normal climatic condition in its original packaging. Before installation, it shall not be extremely dried or frozen.

**The original French version is
signed by**

**Le Directeur Technique
C. BALOCHE**

Schema of the SPIT HIT M anchor in use

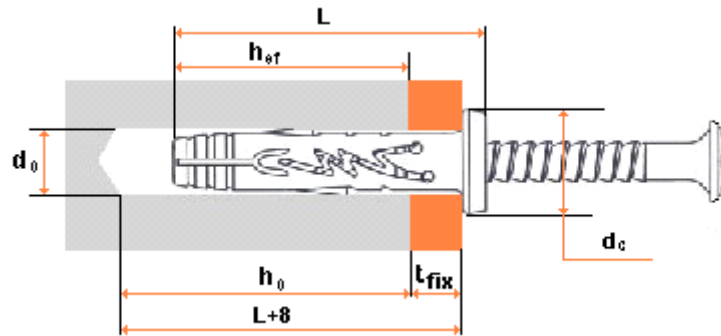

Intended use : anchorage of profiles for ETICS in concrete and masonry.

- L : total length of the plastic sleeve
- h_{ef} : effective anchorage depth
- d_0 : drilled hole diameter
- h_0 : depth of drilled hole
- t_{fix} : thickness of fixture
- d_c : diameter of the collar

t_{fix} , thickness of fixture corresponds to the thickness of the equalizing layer or non loadbearing coating in addition to the thickness of the profile itself.

Table 1 : Materials

Designation	Material	
	Nail	Plastic expansion sleeve
HIT M	Bi-chromated steel or stainless steel A2	Polyamide PA6

SPIT HIT M	Annex 1 of European Technical Approval ETA-06/0032
Intended use and materials	



SPIT HIT M : PLASTIC SLEEVE AND STEEL NAIL / MARKING ON PLASTIC SLEEVE

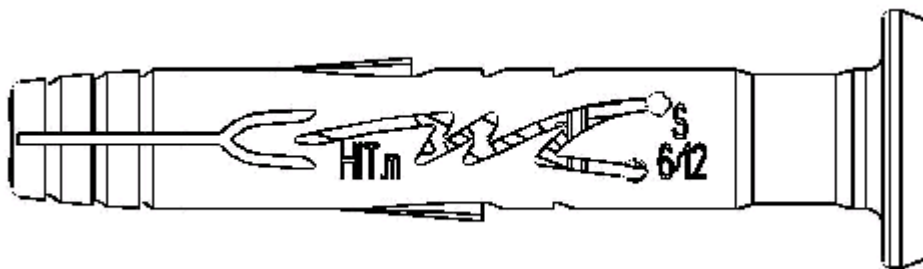


Table 2: Different sizes and combinations of plastic sleeves and steel nails

HIT M $\phi 5$ pansunk head	
HIT M $\phi 6$ pansunk head	
HIT M $\phi 6$ countersunk head	
HIT M $\phi 6$ with threaded part	
HIT M $\phi 8$ pansunk head	
HIT M $\phi 8$ countersunk head	
HIT M $\phi 8$ broad pansunk head (long. 158mm, 178 mm et 198 mm)	

SPIT HIT M

**Different components of the anchor:
sleeves and nails**

Annex 2

of European
Technical Approval
ETA-06/0032

Table 3 : Dimensions of components and installation data

SPIT HIT M	max. Fixture thickness	expansion sleeve diameter and drill hole diameter	Length of the expansion sleeve	Colar diameter	Nail type	nail diameter	Embed. depth	Depth of the drill hole in the support	Nail length			
	t_{fix}	d_{nom} and d_0	L_d	d_c	-	d_s	h_{ef}	h_0	L			
	[mm]	[mm]	[mm]	[mm]	[-]	[mm]	[mm]	[mm]	[mm]			
5-5/27P	5	5	27	9	PZ2	3,5	20	35	32,0			
5-15/37P	15		37						42,0			
6-5/32P	5	6	32	11	PZ2	3,9	25	40	37,0			
6-12/39P	12		39						44,0			
6-25/52P	25		52						57,0			
6-40/67P	40		67						72,0			
6-12/39P	12		39	10					44,0			
6/25/52V	25		52						57,0			
6-40/67V	40		67						72,0			
6/5-M6	-		32						11	thread. M6	30	**
6/5-M7	-		32	thread. M7						**		37,5
8-10/42P	10		8	42					13	PZ2	4,8	30
8-30/62P	30	62		68,5								
8-60/92P	60	92		98,5								
8-80/112P	80	112		118,5								
8-100/132P	100	132		138,5								
8-125/158P	125	158		15	PZ3	163						
8-145/178P	145	178				183						
8-165/198P	165	198				203						
8-30/62V	30	62				11,5	PZ2	68,5				
8-30/92V	60	92		98,5								
8-60/112V	80	112		118,5								
8-100/132V	100	132		138,5								

* SPIT HIT M 5 with embedment depth 20 mm can be used only if it has been checked by appropriate job site tests that the effective characteristic resistance with the base material on site is consistent with the characteristic resistance to tension load indicated in Annex 5 table 5.

**Depth of the drilled hole = $L - t_{fix} + 8\text{mm}$.





SPIT HIT M

Dimensions and installation data

Annex 3

of European
Technical Approval
ETA-06/0032

Table 4 : Base materials

Base material	Dimensions L x l x H [mm]	References	Compressive strength [MPa]
Concrete C15/20	[EN 206-1]	EN 206-1	[EN 206-1]
Concrete C50/60	[EN 206-1]	EN 206-1	[EN 206-1]
Clay brick	 220x110x 55	NF EN 771-1	4.7 (bending test)
Aggregates concrete solid masonry units	 500x150x200	NF EN 771-3	12.5
Horizontally perforated clay bricks	 500x200x200	NF EN 771-1	5.9
Aggregates concrete hollow masonry units	 500x200x200	NF EN 771-3	8.2

SPIT HIT M

Base materials

Annex 4

of European
Technical Approval
ETA-06/0032

Table 5 : Characteristic resistance to tension loads N_{Rk} in concrete and masonry for a single anchor in kN

SPIT HIT M	Concrete C15/20	Concrete C20/25 to C50/60	Clay brick	Aggregates concrete solid masonry units	Horizontally perforated clay bricks	Aggregates concrete hollow masonry units
5-5/27P	0.40	0.60	0.20	0.30	0.30	0.20
5-15/37P						
6-5/32P	0.70	0.90	0.80	0.40	0.40	0.30
6-12/39P						
6-25/52P						
6-40/67P						
6-12/39P						
6/25/52V						
6-40/67V						
6/5-M6						
6/5-M7						
8-10/42P						
8-30/62P						
8-60/92P						
8-80/112P						
8-100/132P						
8-125/158P	0.60	0.90	0.90	0.50	0.50	0.60
8-145/178P						
8-165/198P						
8-30/62V	0.90	1.20	1.20	0.50	0.50	0.60
8-30/92V						
8-60/112V						
8-100/132V						

Table 6 : Minimum spacing and edge distances, dimension of members

Minimum spacing	$S_{min} \geq 100 \text{ mm}$
Minimum edge distance	$C_{min} \geq 100 \text{ mm}$
Minimum thickness of member	$h \geq 100 \text{ mm}$

SPIT HIT M	Annex 5 of European Technical Approval ETA-06/0032
Characteristic resistance to tension loads N_{Rk} Minimum spacing and edge distances	